



EDUS 391001 - R1_a

R-410A

Engineering Data

VRV[®] III

**RXYQ-PAYD
/ PYDNR**

**3 phase
460V, 60Hz**

DAIKIN AC (AMERICAS), INC.

RXYQ-PAYD / PYDNR

Heat Pump

3 phase

460V, 60Hz

1. Specifications	2
2. Dimensions	5
3. Service Space	7
4. Piping Diagrams	8
5. Wiring Diagrams	9
6. Field Wiring	10
7. Electric Characteristics	12
8. Performance	14
9. Capacity Tables (Reference Data)	15
9.1 Cooling Capacity (RXYQ-PAYD / PYDNR)	15
9.2 Heating Capacity (RXYQ-PAYD / PYDNR)	23
9.3 Capacity Correction Factor	39
10. Operation Limits	46
11. Sound Levels	47
12. Accessories	48

1. Specifications

Model Name		RXYQ72PAYD	RXYQ96PAYD	RXYQ108PAYD
Power Supply		3 phase, 460V, 60Hz	3 phase, 460V, 60Hz	3 phase, 460V, 60Hz
Nominal Cooling Capacity★ ¹	Btu / h	72,000	96,000	108,000
Rated Cooling Capacity	Btu / h	70,000	92,000	104,000
Rated Cooling Input Power (System)	kW	5.74	8.29	9.45
Rated Full Load EER (System)★ ^{1,3}		12.2	11.1	11.0
Nominal Heating Capacity★ ²	Btu / h	81,000	108,000	122,000
Rated Heating Capacity	Btu / h	77,000	103,000	116,000
Rated Heating Input Power (System)	kW	6.6	9.1	10.3
Rated Full Load COP (System)★ ^{2,3}		3.4	3.3	3.3
Casing Color		Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)
Dimensions: (HxWxD)	in. (mm)	66-1/8 x 36-5/8 x 30-1/8 (1680 x 930 x765)	66-1/8 x 36-5/8 x 30-1/8 (1680 x 930 x765)	66-1/8 x 36-5/8 x 30-1/8 (1680 x 930 x765)
Heat Exchanger		Cross Fin Coil	Cross Fin Coil	Cross Fin Coil
Comp.	Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type
	Piston Displacement	m ³ /h	10.53+13.34	10.53+13.34
	Number of Revolutions	r.p.m	(2900, 6300)	2900, 6300
	Motor OutputxNumber of Units	kW	(4.7) x 1	(2.2+4.5) x 1
	Starting Method		Soft Start	Soft Start
Fan	Type	Propellor Fan	Propellor Fan	Propellor Fan
	Motor Output	kW	(0.75) x 1	(0.75) x 1
	Air Flow Rate	cfm	6,530	6,530
	Drive		Direct Drive	Direct Drive
Connecting Pipes	Liquid Pipe	in. (mm)	ϕ 3/8 (9.5) C1220T (Brazing Connection)	ϕ 3/8 (9.5) C1220T (Brazing Connection)
	Gas Pipe	in. (mm)	ϕ 3/4 (19.1) C1220T (Brazing Connection)	ϕ 7/8 (22.2) C1220T (Brazing Connection)
Mass	Lbs (kg)	573 (260)	573 (260)	573 (260)
Safety Devices		High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector
Defrost Method		Deicer	Deicer	Deicer
Capacity Control	%	20~100	14~100	14~100
Refrigerant	Refrigerant Name		R-410A	R-410A
	Charge	Lbs (kg)	18.1 (8.2)	19.8 (8.9)
	Control		Electronic Expansion Valve	Electronic Expansion Valve
Standard Accessories		Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps
Drawing No.		C: 4D067217A	C: 4D067218A	C: 4D067219A

Notes:

- ★¹ Indoor temp. : 80°FDB (27°CDB), 67°FWB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★² Indoor temp. : 70°FDB (21°CDB) / outdoor temp. : 47°FDB, 43°FWB (8.3° CDB, 6° CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.
- ★³ The tested system EER and COP values reflect "full load efficiency only and are the results from testing to the **Alternate Test Method** (ATM) guidelines provided by the U.S. Department of Energy (DOE) in the Federal Register / Vol. 74, No. 68 / Friday April 8, 2009 / Notices / Pages 15955-15958.

Model Name (Combination Unit)		RXYQ144PAYD	RXYQ168PAYD	RXYQ192PAYD
Model Name (Independent Unit)		RXYQ72PAYD RXYQ72PAYD	RXYQ72PAYD RXYQ96PAYD	RXYQ96PAYD RXYQ96PAYD
Power Supply		3 phase, 460V, 60Hz	3 phase, 460V, 60Hz	3 phase, 460V, 60Hz
Nominal Cooling Capacity★ ¹	Btu / h	144,000	168,000	192,000
Rated Cooling Capacity	Btu / h	138,000	160,000	184,000
Rated Cooling Input Power (System)	kW	11.31	14.04	17.20
Rated Full Load EER (System)★ ^{1,3}		12.2	11.4	10.7
Nominal Heating Capacity★ ²	Btu / h	162,000	188,000	216,000
Rated Heating Capacity	Btu / h	154,000	180,000	206,000
Rated Heating Input Power (System)	kW	13.3	16.0	18.9
Rated Full Load COP (System)★ ^{2,3}		3.4	3.3	3.2
Casing Color		Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)	Ivory White (5Y7.5/1)
Dimensions: (HxWxD)	in. (mm)	66-1/8 x 36-5/8 x 30-1/8 + 66-1/8 x 36-5/8 x 30-1/8 (1680 x 930 x765 + 1680 x 930 x765)	66-1/8 x 36-5/8 x 30-1/8 + 66-1/8 x 36-5/8 x 30-1/8 (1680 x 930 x765 + 1680 x 930 x765)	66-1/8 x 36-5/8 x 30-1/8 + 66-1/8 x 36-5/8 x 30-1/8 (1680 x 930 x765 + 1680 x 930 x765)
Heat Exchanger		Cross Fin Coil	Cross Fin Coil	Cross Fin Coil
Comp.	Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type	Hermetically Sealed Scroll Type
	Piston Displacement	(m ³ /h)	(10.53+13.34) x 2	16.90 + (10.53+13.34)
	Number of Revolutions	r.p.m	(2900, 6300) x 2	7980, (2900, 6300)
	Motor OutputxNumber of Units	kW	(4.7) x 2	(4.7) x 1 + (2.2+4.5) x 1
Starting Method		Soft Start	Soft Start	Soft Start
Fan	Type	Propellor Fan	Propellor Fan	Propellor Fan
	Motor Output	kW	(0.75) x 1 + (0.75) x 1	(0.75) x 1 + (0.75) x 1
	Air Flow Rate	cfm	6,530+6,530	6,530+6,530
	Drive		Direct Drive	Direct Drive
Connecting Pipes	Liquid Pipe	in. (mm)	φ1/2 (12.7) C1220T (Brazing Connection)	φ5/8 (15.8) C1220T (Brazing Connection)
	High Pressure Equalizer Pipe	in. (mm)	φ3/4 (19.1) C1220T (Brazing Connection)	φ3/4 (19.1) C1220T (Brazing Connection)
	Gas Pipe	in. (mm)	φ1-1/8 (28.6) C1220T (Brazing Connection)	φ1-1/8 (28.6) C1220T (Brazing Connection)
	Low Pressure Equalizer Pipe	in. (mm)	φ3/4 (19.1) C1220T (Brazing Connection)	φ3/4 (19.1) C1220T (Brazing Connection)
Mass	Lbs (kg)	573+573 (260+260)	573+573 (260+260)	573+573 (260+260)
Safety Devices		High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector	High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector
Defrost Method		Deicer	Deicer	Deicer
Capacity Control	%	13~100	9~100	7~100
Refrigerant	Refrigerant Name		R-410A	R-410A
	Charge	Lbs (kg)	18.1+18.1 (8.2+8.2)	18.1+19.8 (8.2+8.9)
	Control		Electronic Expansion Valve	Electronic Expansion Valve
Standard Accessories		Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps	Installation Manual, Operation Manual, Connection Pipes, Clamps
Drawing No.		C: 4D067220A	C: 4D067221A	C: 4D067222A

Notes:

- ★¹ Indoor temp. : 80°FDB(27°CDB), 67°FWB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★² Indoor temp. : 70°FDB(21°CDB) / outdoor temp. : 47°FDB, 43°FWB (8.3° CDB, 6° CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.3)
- ★³ The tested system EER and COP values reflect "full load efficiency only and are the results from testing to the **Alternate Test Method** (ATM) guidelines provided by the U.S. Department of Energy (DOE) in the Federal Register / Vol. 74, No. 68 / Friday April 8, 2009 / Notices / Pages 15955-15958


Model Name (Combination Unit)		RXYQ216PYDNR		RXYQ240PYDNR		
Model Name (Independent Unit)		RXYQ96PAYD RXYQ120PYDNR		RXYQ120PYDNR RXYQ120PYDNR		
Power Supply		3 Phase 60Hz 460V		3 Phase 60Hz 460V		
Nominal Cooling Capacity★1	Btu/h	216,000		240,000		
Rated Cooling Capacity	Btu/h	206,000		240,000		
Rated Cooling Input Power (System)	kW	19.43		24.49		
Rated Full Load EER (System)★1,★3		10.60		9.80		
Nominal Heating Capacity★2	Btu/h	243,000		270,000		
Rated Heating Capacity	Btu/h	232,000		258,000		
Rated Heating Input Power (System)	kW	21.25		23.63		
Rated Full Load COP (System)★2,★3		3.2		3.2		
Casing Color		Ivory White (5Y7.5/1)		Ivory White (5Y7.5/1)		
Dimensions: (HxWxD)	in (mm)	66-1/8 x 36-5/8 x 30-1/8" (1680 x 930 x 765 mm) + 66-1/8 x 36-5/8 x 30-1/8" (1680 x 930 x 765 mm)		66-1/8 x 36-5/8 x 30-1/8" (1680 x 930 x 765 mm) + 66-1/8 x 36-5/8 x 30-1/8" (1680 x 930 x 765 mm)		
Heat Exchanger		Cross Fin Coil		Cross Fin Coil		
Comp.	Type	Hermetically Sealed Scroll Type		Hermetically Sealed Scroll Type		
	Piston Displacement	m ³ /h	(10.53+13.34) × 2		(10.53+13.34) × 2	
	Number of Revolutions	r.p.m	(2900, 6300) × 2		(2900, 6300) × 2	
	Motor Output×Number of Units	kW	(2.2+4.5) × 1 + (3.5+4.5) × 1		(3.5+4.5) × 2	
Starting Method		Soft Start		Soft Start		
Fan	Type	Propellor Fan		Propellor Fan		
	Motor Output	kW	(0.75) × 1 + (0.75) × 1		(0.75) × 1 + (0.75) × 1	
	Air Flow Rate	cfm	6,530+7,060		7,060+7,060	
	Drive		Direct Drive		Direct Drive	
Connecting Pipes	Liquid Pipe ★3	in (mm)	φ 5/8" (15.9mm) C1220T (Brazing Connection)		φ 5/8" (15.9mm) C1220T (Brazing Connection)	
	High Pressure Equalizer Pipe	in (mm)	φ 3/4" (19.1 mm) C1220T (Brazing Connection)		φ 3/4" (19.1 mm) C1220T (Brazing Connection)	
	Gas Pipe ★3	in (mm)	φ 1-1/8" (28.6 mm) C1220T (Brazing Connection)		φ 1-3/8" (34.9 mm) C1220T (Brazing Connection)	
	Low Pressure Equalizer Pipe	in (mm)	φ 3/4" (19.1 mm) C1220T (Brazing Connection)		φ 3/4" (19.1 mm) C1220T (Brazing Connection)	
Mass	Lbs (kg)	573 lbs (259.9 kg) +573 lbs (259.9 kg)		573 lbs (259.9 kg) +573 lbs (259.9 kg)		
Safety Devices		High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector		High Pressure Switch, Fan Driver Overload Protector, Overcurrent Relay, Inverter Overload Protector		
Defrost Method		Deicer		Deicer		
Capacity Control	%	7~100		6~100		
Refrigerant	Refrigerant Name		R-410A		R-410A	
	Charge	Lbs	19.8+20.1		20.1+20.1	
	Control		Electronic Expansion Valve		Electronic Expansion Valve	
Standard Accessories		Installation Manual, Operation Manual, Connection Pipes, Clamps		Installation Manual, Operation Manual, Connection Pipes, Clamps		
Drawing No.		4D059664A		4D059665A		

Notes:

- ★1 Indoor temp. : 80°FDB(27°CDB), 67°FWB(19.4°CWB) / outdoor temp. : 95°FDB (35°CDB) / Equivalent piping length : 25ft (7.5 m), level difference : 0 ft.
- ★2 Indoor temp. : 70°FDB(21°CDB) / outdoor temp. : 47°FDB, 43°FWB (8.3° CDB, 6° CWB) / Equivalent piping length : 25ft (7.5 m), difference : 0 ft.3)
- ★3 The tested system EER and COP values reflect "full load efficiency only and are the results from testing to the **Alternate Test Method (ATM)** guidelines provided by the U.S. Department of Energy (DOE) in the Federal Register / Vol. 74, No. 68 / Friday April 8, 2009 / Notices / Pages 15955-15958


2. Dimensions

RXYQ72, 96, 108PAYD

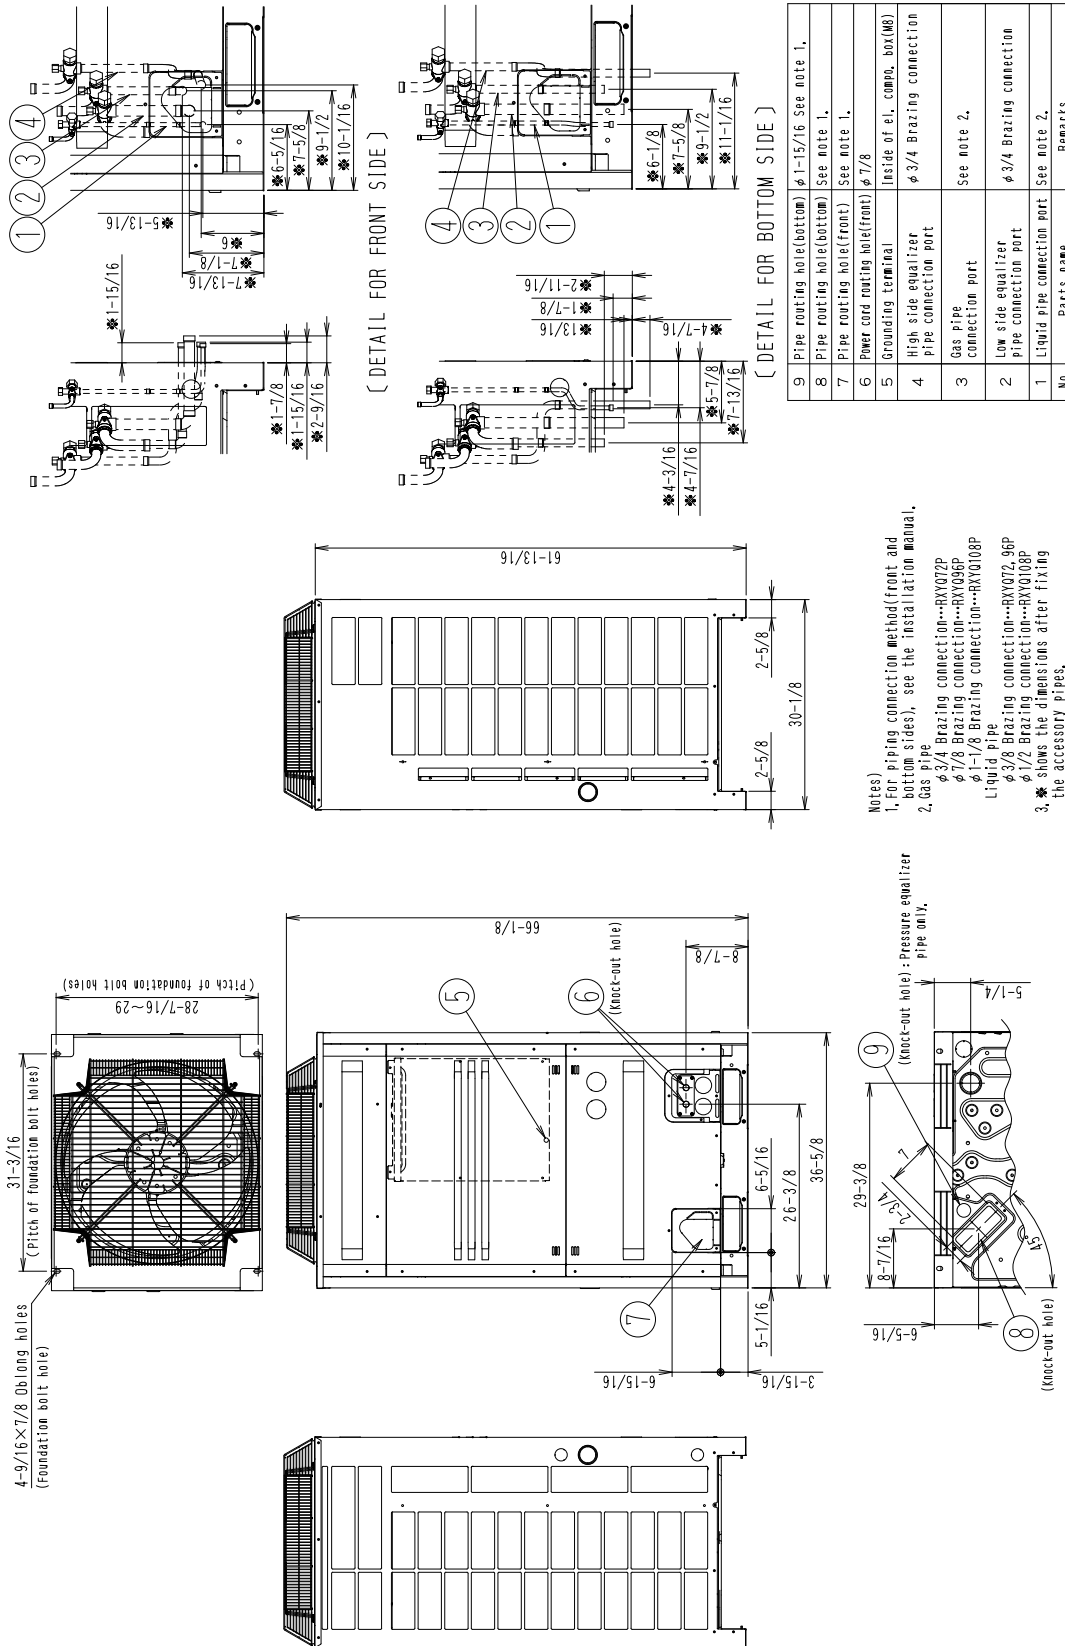

C: 3D056616B

RXYQ144, 168, 192PAYD / 216 ~240PYDNR

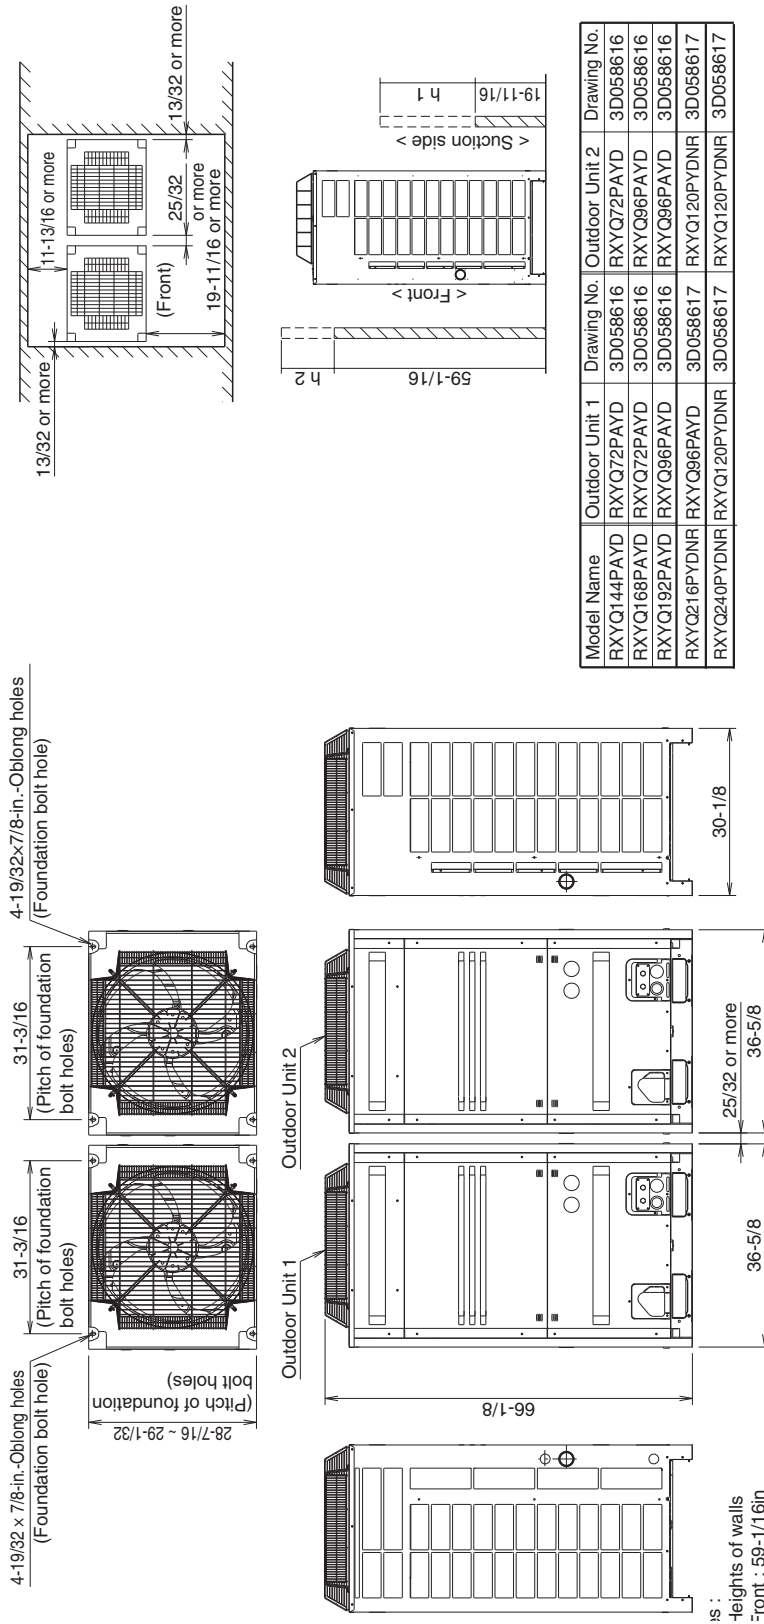

The installation space shown in this figure is based on the condition of cooling operation at the outdoor air temperature of 95°F.

The installation space of suction side shown above must be expanded in the following case.

Design outdoor temperature becomes over 95°F.

Operating over Max. operating load (In case of causing a heavy heating load at indoor unit side)

f the above wall heights are exceeded then h2/2 and h1/2 should be added to the front and suction side service spaces respectively as shown in the following figure.


When installing the units the most appropriate pattern should be selected from those shown above in order to obtain the best fit in the space available always bearing in mind the need to leave enough room or a person to pass between units and wall and for the air to circulate freely.

If more units are to be installed than are catered for in the above patterns your layout should take account of the possibility of short circuits.)

The units should be installed to leave sufficient space at the front for the on site refrigerant piping work to be carried out comfortably.

3. Service Space


RXYQ72,96,144,168,192PAYD, 216~240PYDRN

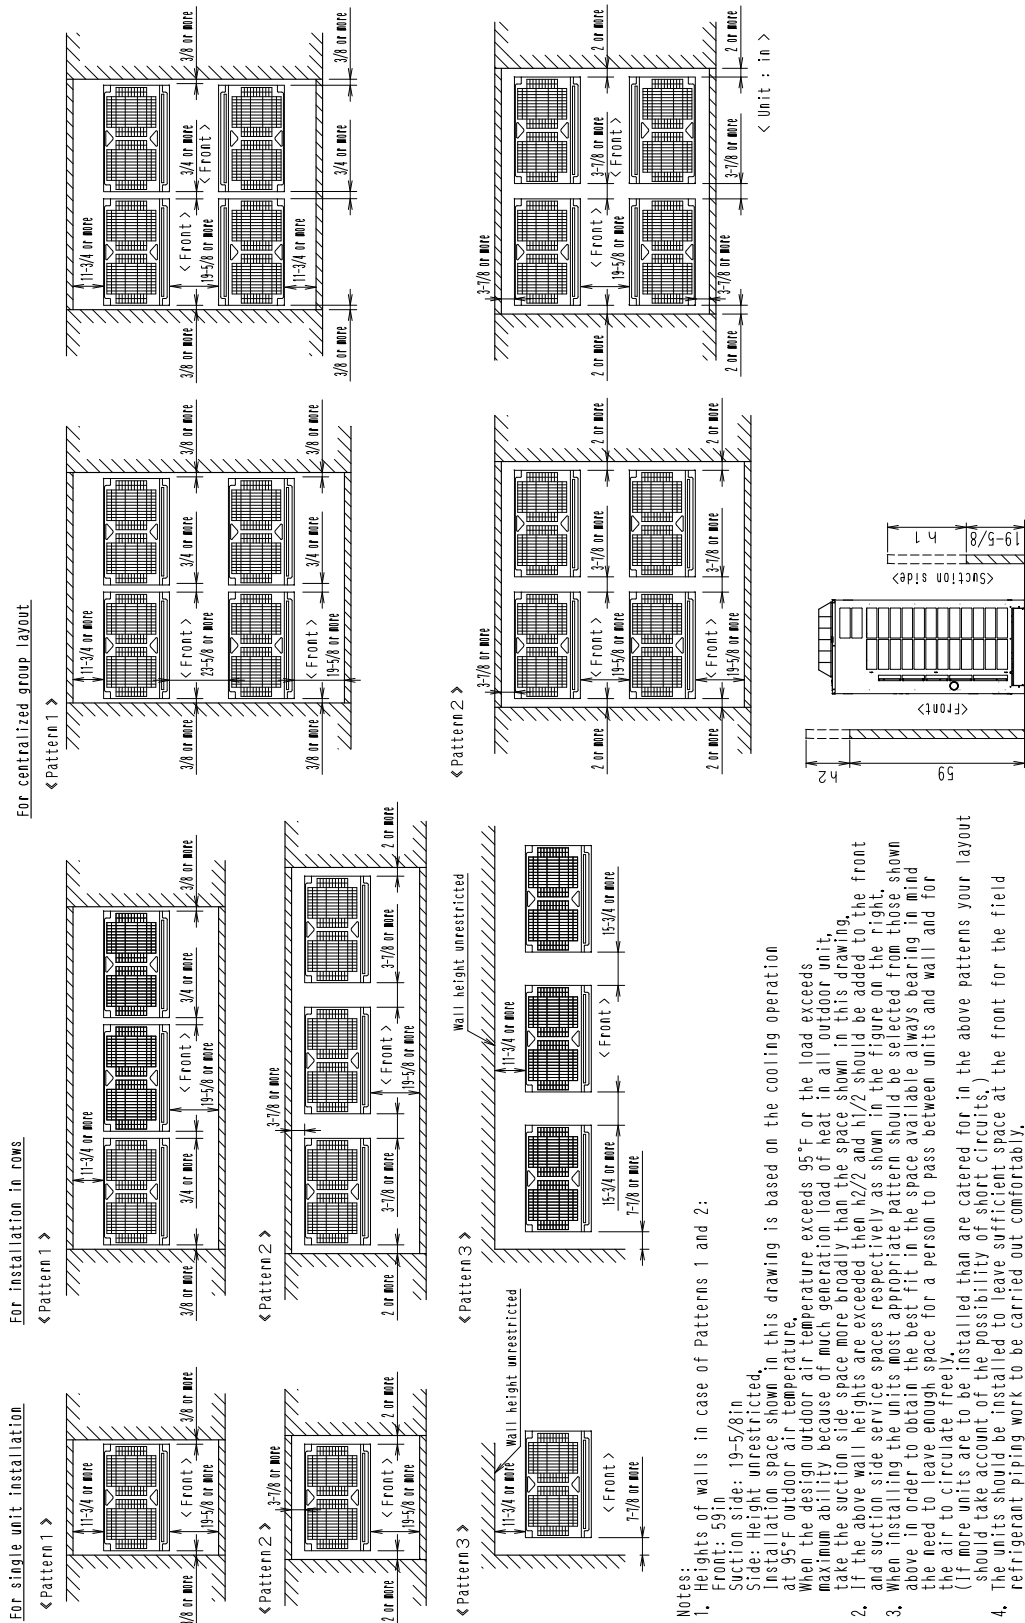

3D058620A

4. Piping Diagrams


RXYQ72, 96, 108PAYD / 120PYDNR

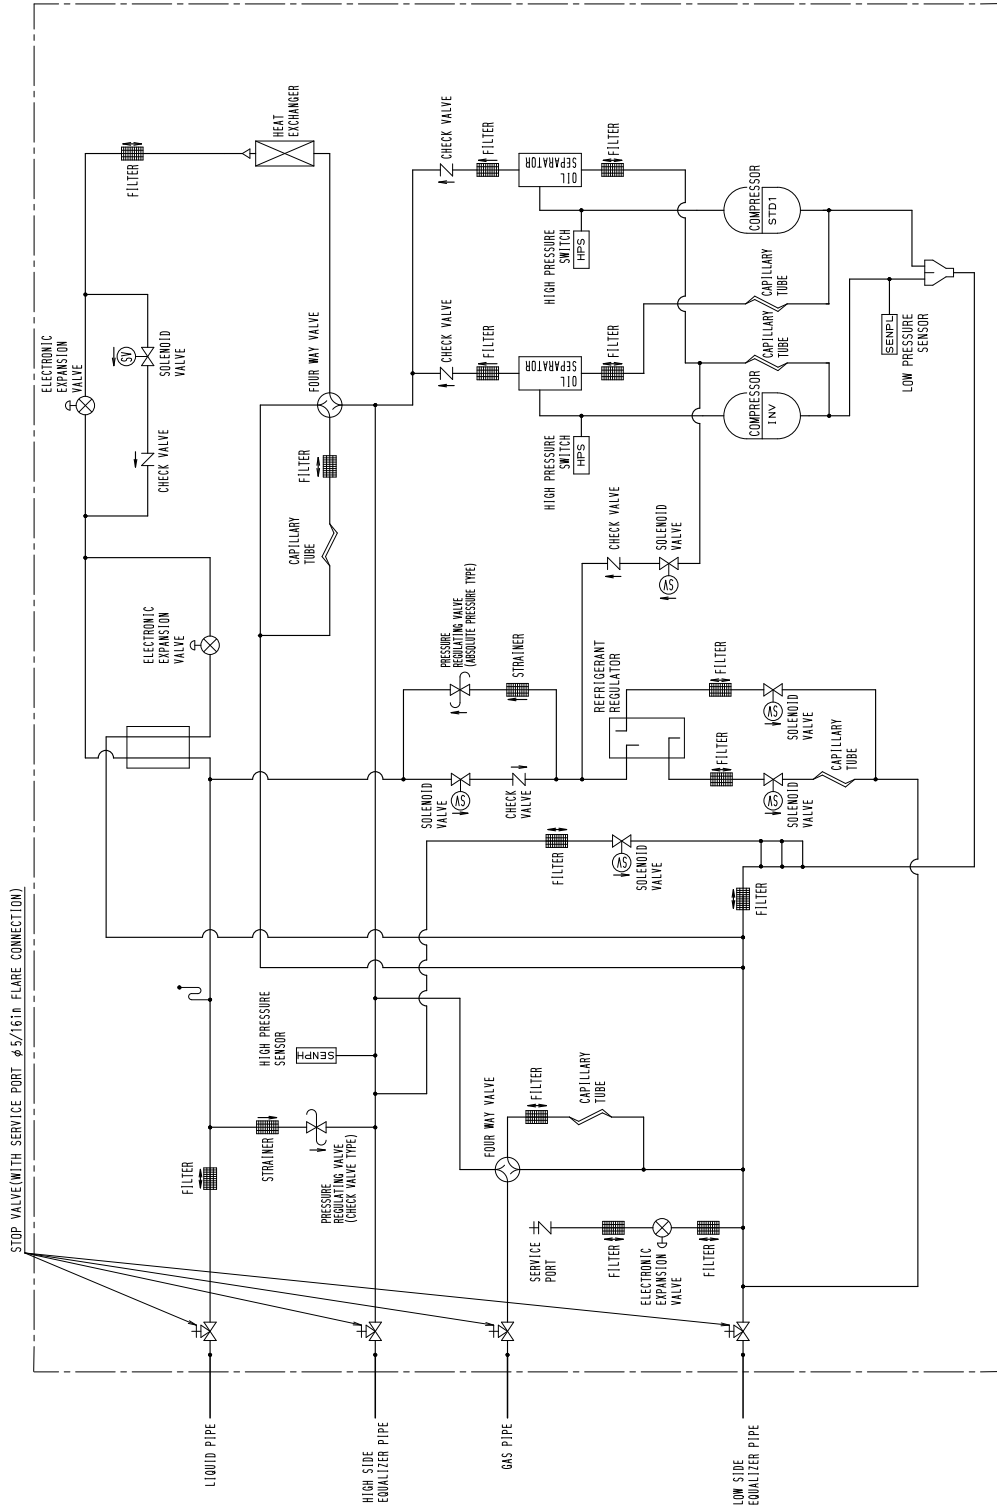

3D058636B

5. Wiring Diagrams

RXYQ72, 96, 108PAYD / 120PYDNR

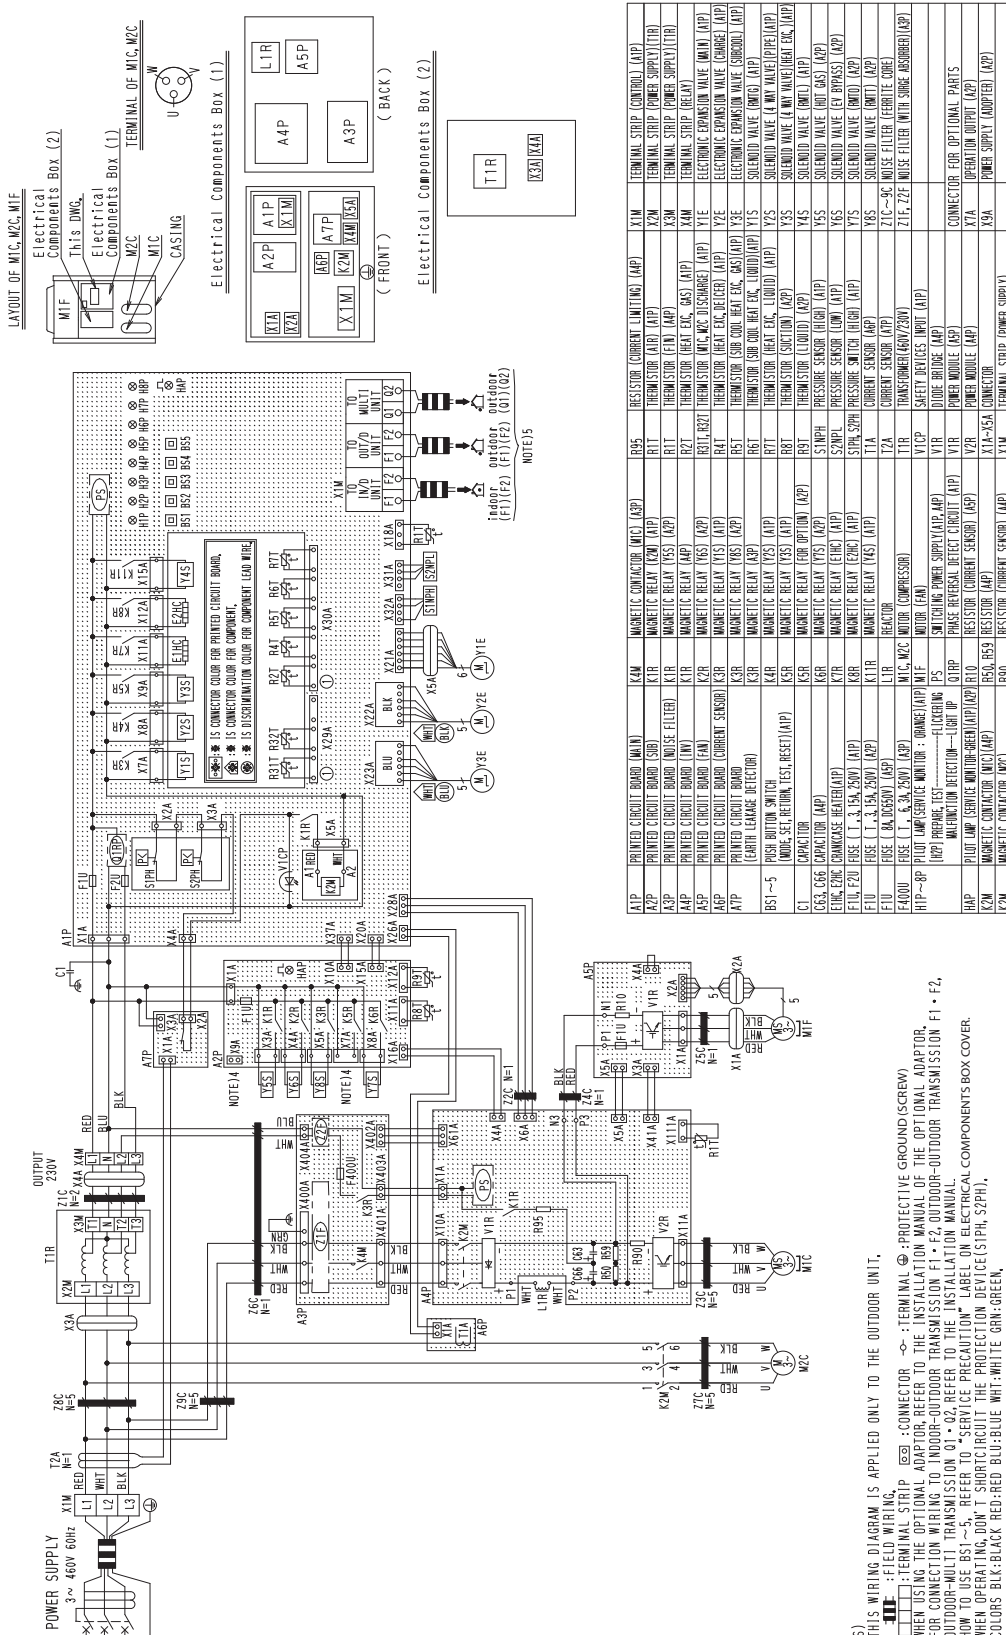

THIS WIRING DIAGRAM IS APPLIED ONLY TO THE OUTDOOR UNIT.
 ■ : FIELD WIRING ○ : TERMINAL ⊕ : PROTECTIVE GROUND (SCREW)
 WHEN USING THE OPTIONAL ADAPTOR, REFER TO THE INSTALLATION MANUAL OF THE OPTIONAL ADAPTOR.
 FOR CONNECTION WIRING TO INDOOR-OUTDOOR TRANSMISSION F1 • F2, OUTDOOR-OUTDOOR TRANSMISSION F1 • F2, OUTDOOR-MULTI TRANSMISSION 01 • 02, REFER TO THE INSTALLATION MANUAL.
 HOW TO USE BS1~5, REFER TO "SERVICE PRECAUTION" LABEL ON ELECTRICAL COMPONENTS BOX COVER.
 WHEN OPERATING, DON'T SHORT-CIRCUIT THE PROTECTION DEVICE (STEP S2PH).
 * COLORS: BLK:BLACK RED:RED BLU:BLUE WHI:WHITE GRN:GREEN.

A1P	PRINTED CIRCUIT BOARD (MAIN)	K4M	MAGNETIC CONTACTOR (VFC) (RPT)	B05	RESISTOR (CURRENT LIMITING) (APP)	X1M	TERMINAL STRIP (CONTROL) (APP)
A2P	PRINTED CIRCUIT BOARD (SUB)	K1R	MAGNETIC RELAY (FOR RPT)	B1T	TERMINATOR (FOR APP)	X2M	TERMINAL STRIP (POWER SUPPLY) (1TB)
A3P	PRINTED CIRCUIT BOARD (MUSE FILTER)	K1R	MAGNETIC RELAY (FS) (APP)	B1T	TERMINATOR (FOR APP)	X3M	TERMINAL STRIP (POWER SUPPLY) (1TB)
A4P	PRINTED CIRCUIT BOARD (FAN)	K1R	MAGNETIC RELAY (APP)	B2T	TERMINATOR (HEAT EXC. GAS) (APP)	X4M	TERMINAL STRIP (HEAT)
A5P	PRINTED CIRCUIT BOARD (FAN)	K2R	MAGNETIC RELAY (TSS) (APP)	B3T, B3T	TERMINATOR (M/C DISCHARGE) (APP)	Y1E	ELECTRONIC EXPANSION VALVE (MAIN) (APP)
A7P	PRINTED CIRCUIT BOARD (CURRENT SENSOR)	K3R	MAGNETIC RELAY (TSS) (APP)	B4T	TERMINATOR (HEAT EXC. DETECTOR) (APP)	Y2E	ELECTRONIC EXPANSION VALVE (SHORTEL) (APP)
A7P	PRINTED CIRCUIT BOARD (GAS)	K3R	MAGNETIC RELAY (TSS) (APP)	B5T	TERMINATOR (SHO. COIL HEAT EXC. GAS) (APP)	Y3E	ELECTRONIC EXPANSION VALVE (SHORTEL) (APP)
BS1-5	PUSH BUTTON SWITCH (MODE SET, RETURN TEST, RESET) (APP)	K4R	MAGNETIC RELAY (TSS) (APP)	B6T	TERMINATOR (SHO. COIL HEAT EXC. LIQUID) (APP)	Y2S	SOLENOID VALVE (4 WAY VALVE) (APP)
C1	CAPACITOR	K5R	MAGNETIC RELAY (TSS) (APP)	B7T	TERMINATOR (SUCTION) (APP)	Y3S	SOLENOID VALVE (4 WAY VALVE) (HEAT EXC. APP)
C63, C66	CAPACITOR (APP)	K6R	MAGNETIC RELAY (TSS) (APP)	B7T	TERMINATOR (LIQUID) (APP)	Y4S	SOLENOID VALVE (BOTH) (APP)
ETHC, ETHC	CIRCUIT BOARD (HEATER) (APP)	K7R	MAGNETIC RELAY (TSS) (APP)	S1M1PH	PRESSURE SENSOR (HIGH) (APP)	Y5S	SOLENOID VALVE (BOTH) (APP)
F1U, F2U	FUSE (1.3, 1.5A, 2.0V) (APP)	K8R	MAGNETIC RELAY (ETHC) (APP)	S2M1PH	PRESSURE SENSOR (LOW) (APP)	Y6S	SOLENOID VALVE (EX. BYPASS) (APP)
F1U	FUSE (1.3, 1.5A, 2.0V) (APP)	K11R	MAGNETIC RELAY (TSS) (APP)	T1A	CURRENT SENSOR (APP)	Y8S	SOLENOID VALVE (BOTH) (APP)
F1U	FUSE (6A, 1000V) (APP)	L1R	REACTOR	T2A	CURRENT SENSOR (APP)	Z1C	MUSE FILTER (FERRITE CORE)
F400U	FUSE (1.1, 3A, 250V) (APP)	M/C, M2C	MOTOR (COMPRESSOR)	T2A	TRANSFORMER (40V/200V)	Z1F, Z2F	MUSE FILTER (WITH SHORTEL) (APP)
H1P-0P	PILOT LAMP (SERVICE WATCH - ORANGE) (APP)	MIF	MOTOR (FAN)	T1R	SAFETY DEVICES (MOT) (APP)		
H1P-0P	PILOT LAMP (SERVICE WATCH - BLUE) (APP)	PHS	PHASE REVERSAL PROTECTION (APP)	V1P	DIODE BRIDGE (APP)		
H1P	PILOT LAMP (SERVICE WATCH - GREEN) (APP)	PIB	PHASE REVERSAL DEFECT CIRCUIT (APP)	V1R	DIODE BRIDGE (APP)		
K2M	MAGNETIC CONTACTOR (M/C) (APP)	R10	RESISTOR (CURRENT SENSOR) (APP)	V2R	DIODE MODULE (APP)	X1A	CONNECTOR FOR OPTIONAL PARTS (OPERATION OUTPUT) (APP)
K2M	MAGNETIC CONTACTOR (M/C)	B50A, B50B	RESISTOR (APP)	X1M-NSA	CONNECTOR	X9A	POWER SUPPLY (ADAPTOR) (APP)
K2M	MAGNETIC CONTACTOR (M/C)	B50	RESISTOR (CURRENT SENSOR) (APP)	X1W	TERMINAL STRIP (POWER SUPPLY)		


3D066950

6. Field Wiring

RXYQ72, 96, 108PAYD

- Notes 1) All wiring, components and materials to be procured on the site must comply with the applicable local and national codes, 2) Use copper conductors only, 3) As for details, see wiring diagram, 4) Install earth leakage circuit breaker for safety, 5) All field wiring and components must be provided by licensed electrician,
- 6) Unit shall be grounded in compliance with the applicable local and national codes, 7) Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation, 8) Be sure to install the switch and the fuse to the power line of each equipment, 9) Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing the multiple power sources, 10) If there exists the possibility of reversed phase, lose phase, momentary blackout or the power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
- Running the product in reversed phase may break the compressor and other parts.

- Notes 1) All wiring, components and materials to be procured on the site must comply with the applicable local and national codes, 2) Use copper conductors only, 3) As for details, see wiring diagram, 4) Install earth leakage circuit breaker for safety, 5) All field wiring and components must be provided by licensed electrician,

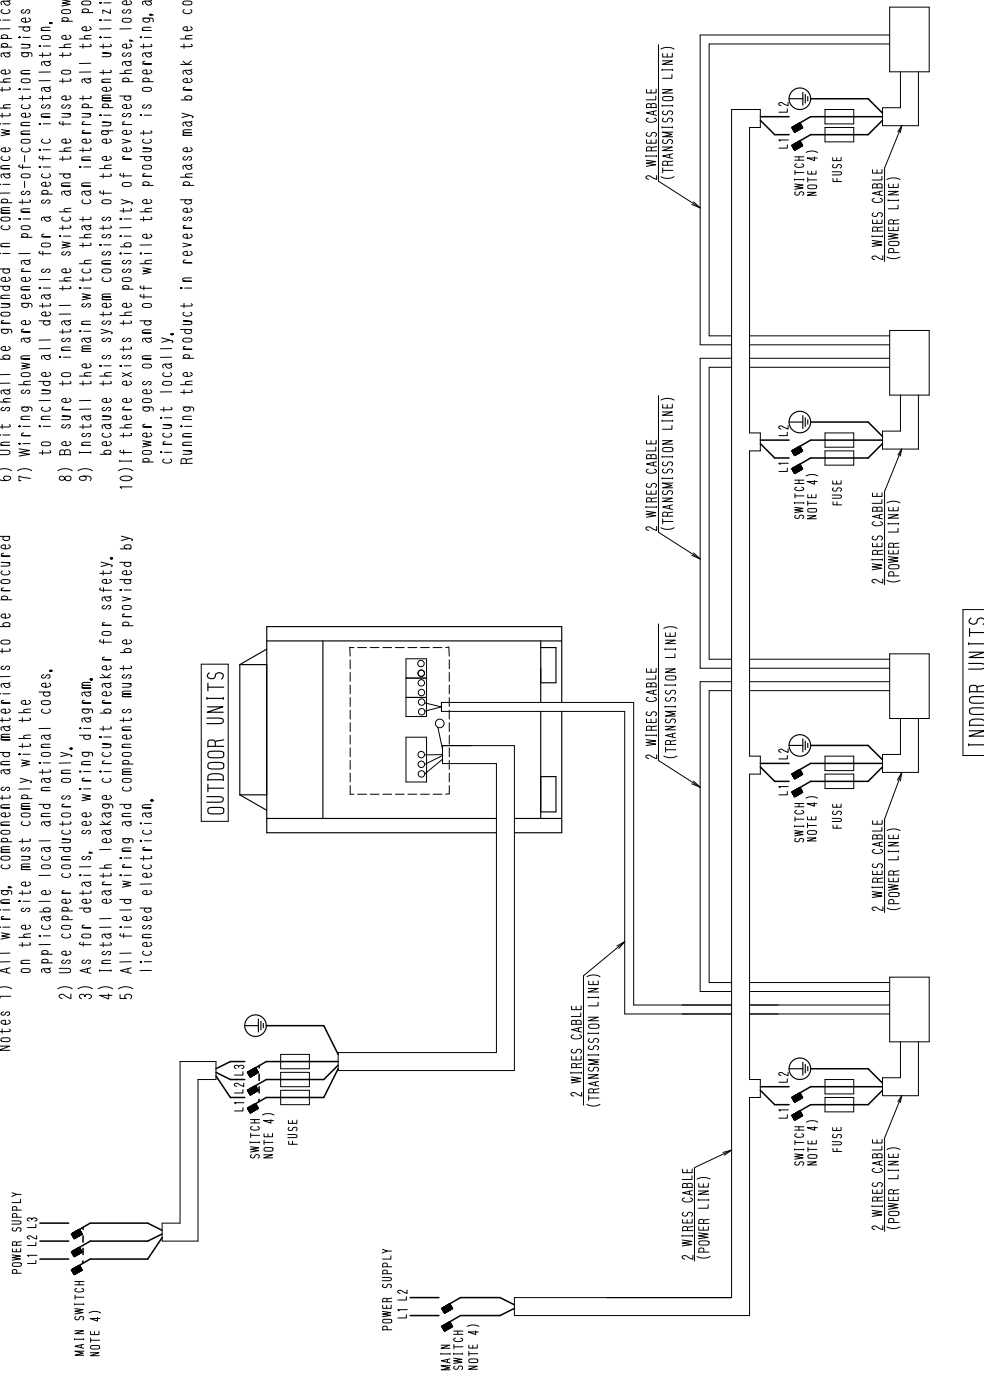


3D058621C

RXYQ144, 168, 192PAYD / 216~240PYDNR

- Notes 1) All wiring, components and materials to be procured on the site must comply with the applicable local and national codes, to include all details for a specific installation.
- 2) Use copper conductors only.
- 3) As for details, see wiring diagram.
- 4) Install earth leakage circuit breaker for safety.
- 5) All field wiring and components must be provided by licensed electrician.
- 6) Unit shall be grounded in compliance with the applicable local and national codes.
- 7) Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
- 8) Be sure to install the switch and the fuse to the power line of each equipment.
- 9) Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing the multiple power sources.
- 10) The capacity of UNIT1 must be larger than UNIT2 when the power source is connected in series between the units.
- 11) If there exists the possibility of reversed phase, lose phase, momentary blackout or the power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
- Running the product in reversed phase may break the compressor and other parts.

When the power source is supplied to each outdoor unit individually.

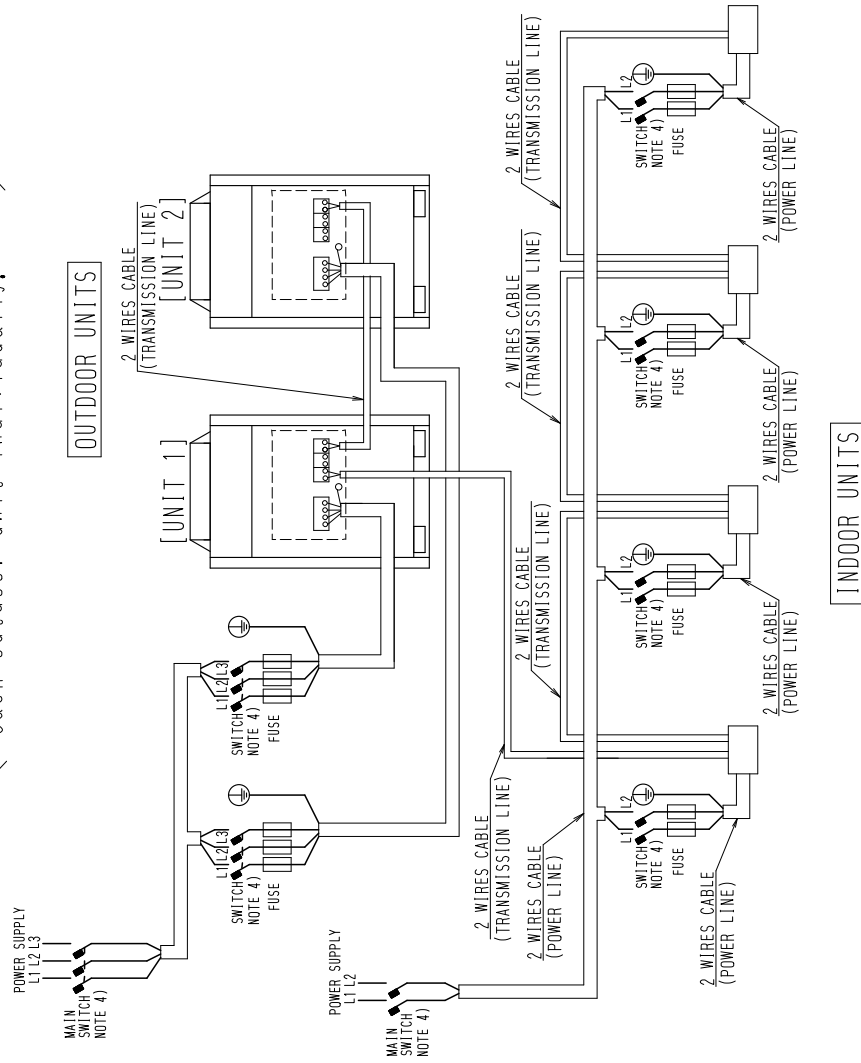


3D069672C

7. Electric Characteristics

Model Name	Units				Power supply		Comp.		OFM	
	Hz	Volts	Min.	Max.	MCA	MOP	MSC	RLA	KW	FLA
RXYQ72PAYD	60	460	416	508	20.2	25	65	7.1	0.75	0.6
RXYQ96PAYD	60	460	416	508	20.3	25	65	3.9+8.4	0.75	0.8
RXYQ108PAYD	60	460	416	508	20.5	30	65	6.1+8.4	0.75	1.0

The relationship between the starting time and the starting current.

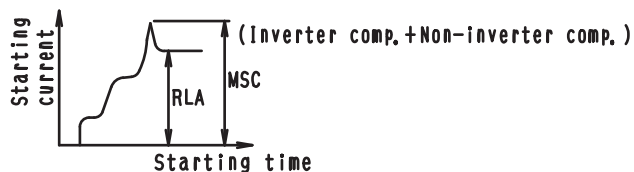

Notes:

1. RLA is based on the following conditions.
Indoor temp, 80°FDB/67°FWB
Outdoor temp, 95°FDB
2. MSC means the Max. current during the starting of compressor.
3. Voltage range
Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
4. Maximum allowable voltage variation between phases is 2%.
5. Select wire size based on the value of MCA.
6. MOP is used to select the circuit breaker and the ground fault circuit interrupter (ground leakage circuit breaker).


Symbols:

- MCA :Min. Circuit Amps. (A)
- MOP :Maximum Overcurrent Protection (A)
- MSC :Max. Starting current
- RLA :Rated Load Amps. (A)
- OFM :Outdoor Fan Motor
- FLA :Full Load Amps. (A)
- kW :Rated Motor Output(kw)

3D067246

Combination Unit	Model Name		Units				Power supply		Comp.			OFM	
	Independent Unit		Hz	Volts	Min.	Max.	MCA	MOP	MSC	RLA	KW	FLA	
RXYQ144PAYD	RXYQ72PAYD	RXYQ72PAYD	60	460	416	508	20.2 + 20.2	25 + 25	69	7, 1+7, 1	0.75 + 0.75	0.6 + 0.6	
RXYQ168PAYD	RXYQ72PAYD	RXYQ96PAYD	60	460	416	508	20.2 + 20.3	25 + 25	69	7, 1+3, 9+8, 4	0.75 + 0.75	0.6 + 0.6	
RXYQ192PAYD	RXYQ96PAYD	RXYQ96PAYD	60	460	416	508	20.3 + 20.3	25 + 25	69	3, 9+8, 4+3, 9+8, 4	0.75 + 0.75	0.8 + 0.8	
RXYQ216PYDNR	RXYQ96PAYD	RXYQ120PYDNR	60	460	416	508	20.5 + 20.3	25 + 30	77	3.9 + 8.4+ 6.1 +8.4	0.75 + 0.75	0.8 + 1.0	
RXYQ240PYDNR	RXYQ120PYDNR	RXYQ120PYDNR	60	460	416	508	20.5 + 20.5	30 + 30	77	6.1+ 8.4+ 6.1 +8.4	0.75 + 0.75	1.0 + 1.0	

The relationship between the starting time and the starting current.

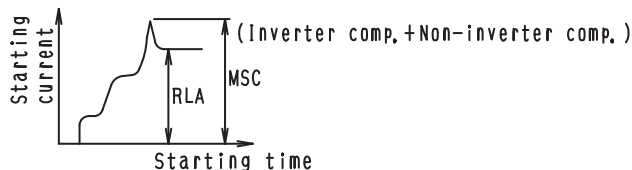

Notes:

1. RLA is based on the following conditions,
Indoor temp, 80°F DB/67, 0°F WB
Outdoor temp, 95°F DB
2. MSC means the Max, current during the starting of compressor.
3. Voltage range
Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
4. Maximum allowable voltage variation between phases is 2%.
5. Select wire size based on the value of MCA.
6. MOP is used to select the circuit breaker and the ground fault circuit interrupter **(ground leakage circuit breaker).**

Symbols:

- MCA :Minimum Circuit Amps (A)
- MOP :Maximum Overcurrent Protection (A)
- MSC :Max, Starting current
- RLA :Rated Load Amps, (A)
- OFM :Outdoor Fan Motor
- FLA :Full Load Amps, (A)
- kW :Rated Motor Output(kW)

C: 3D067250B

8. Performance

With these new models Daikin can publish full load EER and COP ratings reflective of a complete system comprised of an outdoor unit and ducted indoor units for the new VRV III product portfolio. Ducted indoor units were chosen to provide complete transparency to the market place and ensure both ducted and ductless combinations meet the minimum efficiency levels.

The VRV III PA RXYQ_PAYD outdoor unit shall perform as indicated below.

The tested system EER and COP values reflect “full load” efficiency only and are the results from testing to the “Alternate Test Method” (ATM) guidelines provided by the U.S. Department of Energy (DOE) in the Federal Register / Vol. 74, No. 68 / Friday April 10, 2009 / Notices / Pages 16373 – 16377. All tested values surpass the minimum efficiency levels regulated in the DOE Code of Federal Regulation 10 CFR Ch. II § 431.97.

Model Number	EER
RXYQ72PAYD	12.2
RXYQ96PAYD	11.1
RXYQ108PAYD	11.0
RXYQ144PAYD	12.2
RXYQ168PAYD	11.4
RXYQ192PAYD	10.7
RXYQ216PYDNR	10.6
RXYQ240PYDNR	9.8

Model Number	COP
RXYQ72PAYD	3.4
RXYQ96PAYD	3.3
RXYQ108PAYD	3.3
RXYQ144PAYD	3.4
RXYQ168PAYD	3.3
RXYQ192PAYD	3.2
RXYQ216PYDNR	3.2
RXYQ240PYDNR	3.2

Performance Conditions

Cooling: indoor temp. of 80°F DB, 67°F WB and outdoor temp. of 95°F DB.

Heating: indoor temp. of 70°F DB and outdoor temp. of 47°F DB, 43°F WB.

Equivalent piping length: 25ft

9. Capacity Tables (Reference Data)

9.1 Cooling Capacity (RXYQ-PAYD / PYDNR)

These tables are based on projection. Actual results may vary according to conditions of use.

RXYQ72PAYD

Cooling capacity

Cooling capacity

Outdoor air temp. (°F/DB)	Combi-nation (%)	Indoor air temp. °F/WB													
		57		61		64		67		70		72		75	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
90	90	50	160	51.1	1.87	58.0	2.26	64.8	2.56	71.6	2.87	78.2	3.08	83.0	3.41
		54	163	51.1	2.01	58.0	2.30	64.8	2.61	71.6	2.98	78.2	3.15	83.0	3.48
		58	166	51.1	2.15	58.0	2.34	64.8	2.65	71.6	3.06	78.2	3.22	83.0	3.55
		62	169	51.1	2.29	58.0	2.38	64.8	2.70	71.6	3.13	78.2	3.29	83.0	3.62
		66	173	51.1	2.43	58.0	2.42	64.8	2.75	71.6	3.20	78.2	3.36	83.0	3.69
		70	176	51.1	2.57	58.0	2.46	64.8	2.80	71.6	3.27	78.2	3.43	83.0	3.76
		72	178	51.1	2.61	58.0	2.50	64.8	2.84	71.6	3.30	78.2	3.46	83.0	3.79
		74	181	51.1	2.75	58.0	2.54	64.8	2.88	71.6	3.33	78.2	3.49	83.0	3.82
		76	184	51.1	2.89	58.0	2.58	64.8	2.92	71.6	3.36	78.2	3.52	83.0	3.85
		78	187	51.1	3.03	58.0	2.62	64.8	2.96	71.6	3.39	78.2	3.55	83.0	3.88
		80	190	51.1	3.17	58.0	2.66	64.8	3.00	71.6	3.42	78.2	3.58	83.0	3.91
		82	193	51.1	3.31	58.0	2.70	64.8	3.04	71.6	3.45	78.2	3.61	83.0	3.94
80	80	50	142	45.5	1.73	51.5	1.98	57.6	2.24	63.7	2.51	67.7	2.69	73.8	2.97
		54	145	45.5	1.87	51.5	2.02	57.6	2.29	63.7	2.56	67.7	2.75	73.8	3.03
		58	147	45.5	2.01	51.5	2.06	57.6	2.33	63.7	2.61	67.7	2.81	73.8	3.10
		62	150	45.5	2.15	51.5	2.11	57.6	2.38	63.7	2.67	67.7	2.87	73.8	3.17
		66	153	45.5	2.29	51.5	2.15	57.6	2.43	63.7	2.73	67.7	2.93	73.8	3.24
		70	156	45.5	2.43	51.5	2.20	57.6	2.48	63.7	2.79	67.7	3.00	73.8	3.31
		72	158	45.5	2.57	51.5	2.24	57.6	2.53	63.7	2.85	67.7	3.07	73.8	3.38
		74	161	45.5	2.71	51.5	2.28	57.6	2.58	63.7	2.91	67.7	3.14	73.8	3.45
		76	163	45.5	2.85	51.5	2.32	57.6	2.63	63.7	2.97	67.7	3.21	73.8	3.52
		78	165	45.5	2.99	51.5	2.36	57.6	2.68	63.7	3.03	67.7	3.28	73.8	3.59
		80	167	45.5	3.13	51.5	2.40	57.6	2.73	63.7	3.09	67.7	3.35	73.8	3.66
		82	169	45.5	3.27	51.5	2.44	57.6	2.78	63.7	3.15	67.7	3.42	73.8	3.73
70	70	50	125	39.8	1.51	48.1	1.72	50.4	1.94	55.7	2.16	59.2	2.31	64.6	2.55
		54	127	39.8	1.65	48.1	1.76	50.4	1.98	55.7	2.20	59.2	2.35	64.6	2.59
		58	130	39.8	1.79	48.1	1.80	50.4	2.01	55.7	2.25	59.2	2.41	64.6	2.65
		62	132	39.8	1.93	48.1	1.84	50.4	2.05	55.7	2.30	59.2	2.46	64.6	2.71
		66	134	39.8	2.07	48.1	1.88	50.4	2.09	55.7	2.35	59.2	2.51	64.6	2.77
		70	137	39.8	2.21	48.1	1.92	50.4	2.13	55.7	2.40	59.2	2.56	64.6	2.83
		72	139	39.8	2.35	48.1	1.96	50.4	2.17	55.7	2.45	59.2	2.61	64.6	2.89
		74	141	39.8	2.49	48.1	2.00	50.4	2.21	55.7	2.50	59.2	2.66	64.6	2.95
		76	143	39.8	2.63	48.1	2.04	50.4	2.25	55.7	2.55	59.2	2.71	64.6	3.01
		78	145	39.8	2.77	48.1	2.08	50.4	2.29	55.7	2.60	59.2	2.76	64.6	3.07
		80	147	39.8	2.91	48.1	2.12	50.4	2.33	55.7	2.65	59.2	2.81	64.6	3.13
		82	149	39.8	3.05	48.1	2.16	50.4	2.37	55.7	2.70	59.2	2.86	64.6	3.19
60	60	50	109	34.1	1.33	38.6	1.47	43.2	1.64	47.8	1.83	50.8	1.95	55.3	2.14
		54	111	34.1	1.47	38.6	1.51	43.2	1.68	47.8	1.86	50.8	1.99	55.3	2.19
		58	113	34.1	1.61	38.6	1.55	43.2	1.71	47.8	1.90	50.8	2.03	55.3	2.24
		62	115	34.1	1.75	38.6	1.59	43.2	1.75	47.8	1.94	50.8	2.07	55.3	2.29
		66	117	34.1	1.89	38.6	1.63	43.2	1.79	47.8	1.98	50.8	2.11	55.3	2.34
		70	119	34.1	2.03	38.6	1.67	43.2	1.83	47.8	2.02	50.8	2.15	55.3	2.39
		72	121	34.1	2.17	38.6	1.71	43.2	1.87	47.8	2.06	50.8	2.19	55.3	2.44
		74	123	34.1	2.31	38.6	1.75	43.2	1.91	47.8	2.10	50.8	2.23	55.3	2.49
		76	125	34.1	2.45	38.6	1.79	43.2	1.95	47.8	2.14	50.8	2.27	55.3	2.54
		78	127	34.1	2.59	38.6	1.83	43.2	1.99	47.8	2.18	50.8	2.31	55.3	2.59
		80	129	34.1	2.73	38.6	1.87	43.2	2.03	47.8	2.22	50.8	2.35	55.3	2.64
		82	131	34.1	2.87	38.6	1.91	43.2	2.07	47.8	2.26	50.8	2.39	55.3	2.69

TC: Total capacity ; MBH
 PI: Power Input ; kW (Comp.+Outdoor fan motor)
 Note 1 : The above table shows the average value of conditions which may occur.

RXYQ96PAYD

			Cooling capacity													
Combi- nation (%)	Outdoor air temp. (°F/DB)	Outdoor air temp. (°C)	Indoor air temp. -FWB													
			67			70			72			75				
			TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH		
90	50	54	56.1	2.85	68.2	3.13	77.3	3.59	86.4	4.08	95.5	4.57	102	4.91	111	5.42
			58.1	2.80	68.2	3.19	77.3	3.67	86.4	4.16	95.5	4.67	102	5.01	111	5.54
			60.1	2.75	68.2	3.26	77.3	3.75	86.4	4.25	95.5	4.77	102	5.15	111	5.66
			62.1	2.70	68.2	3.32	77.3	3.82	86.4	4.35	95.5	4.87	102	5.29	111	5.78
			64.1	2.65	68.2	3.39	77.3	3.91	86.4	4.44	95.5	4.98	102	5.45	111	5.90
			66.1	2.60	68.2	3.46	77.3	3.99	86.4	4.54	95.5	5.09	102	5.61	111	6.02
	70	56.1	2.84	68.2	3.13	77.3	3.59	86.4	4.14	95.5	4.63	102	5.13	109	5.65	
		58.1	2.81	68.2	3.19	77.3	3.67	86.4	4.24	95.5	4.74	102	5.25	109	5.77	
		60.1	2.78	68.2	3.26	77.3	3.75	86.4	4.34	95.5	4.85	102	5.37	109	5.89	
		62.1	2.75	68.2	3.32	77.3	3.82	86.4	4.44	95.5	4.96	102	5.49	109	6.01	
		64.1	2.72	68.2	3.39	77.3	3.91	86.4	4.54	95.5	5.07	102	5.61	109	6.13	
		66.1	2.69	68.2	3.46	77.3	3.99	86.4	4.64	95.5	5.18	102	5.73	109	6.25	
80	50	54	56.1	2.88	68.2	3.13	77.3	3.59	86.4	4.32	92.4	4.79	83.6	5.31	93.8	5.85
			58.1	2.85	68.2	3.19	77.3	3.67	86.4	4.42	92.4	4.89	83.6	5.43	93.8	5.97
			60.1	2.82	68.2	3.26	77.3	3.75	86.4	4.52	92.4	5.00	83.6	5.55	93.8	6.09
			62.1	2.79	68.2	3.32	77.3	3.82	86.4	4.62	92.4	5.11	83.6	5.67	93.8	6.21
			64.1	2.76	68.2	3.39	77.3	3.91	86.4	4.72	92.4	5.22	83.6	5.79	93.8	6.33
			66.1	2.73	68.2	3.46	77.3	3.99	86.4	4.82	92.4	5.33	83.6	5.91	93.8	6.45
	70	56.1	2.87	68.2	3.13	77.3	3.59	86.4	4.51	92.4	5.06	83.6	5.67	93.8	6.21	
		58.1	2.84	68.2	3.19	77.3	3.67	86.4	4.61	92.4	5.17	83.6	5.79	93.8	6.33	
		60.1	2.81	68.2	3.26	77.3	3.75	86.4	4.71	92.4	5.28	83.6	5.91	93.8	6.45	
		62.1	2.78	68.2	3.32	77.3	3.82	86.4	4.81	92.4	5.39	83.6	6.03	93.8	6.57	
		64.1	2.75	68.2	3.39	77.3	3.91	86.4	4.91	92.4	5.50	83.6	6.15	93.8	6.69	
		66.1	2.72	68.2	3.46	77.3	3.99	86.4	5.01	92.4	5.61	83.6	6.27	93.8	6.81	
100	50	54	56.1	2.92	68.2	3.13	77.3	3.59	86.4	4.85	92.4	5.49	83.6	6.03	93.8	6.57
			58.1	2.89	68.2	3.19	77.3	3.67	86.4	4.95	92.4	5.60	83.6	6.15	93.8	6.69
			60.1	2.86	68.2	3.26	77.3	3.75	86.4	5.05	92.4	5.71	83.6	6.27	93.8	6.81
			62.1	2.83	68.2	3.32	77.3	3.82	86.4	5.15	92.4	5.82	83.6	6.39	93.8	6.93
			64.1	2.80	68.2	3.39	77.3	3.91	86.4	5.25	92.4	5.93	83.6	6.51	93.8	7.05
			66.1	2.77	68.2	3.46	77.3	3.99	86.4	5.35	92.4	6.04	83.6	6.63	93.8	7.17
	70	56.1	2.91	68.2	3.13	77.3	3.59	86.4	5.04	92.4	5.89	83.6	6.45	93.8	7.05	
		58.1	2.88	68.2	3.19	77.3	3.67	86.4	5.14	92.4	6.00	83.6	6.57	93.8	7.17	
		60.1	2.85	68.2	3.26	77.3	3.75	86.4	5.24	92.4	6.11	83.6	6.69	93.8	7.29	
		62.1	2.82	68.2	3.32	77.3	3.82	86.4	5.34	92.4	6.22	83.6	6.81	93.8	7.41	
		64.1	2.79	68.2	3.39	77.3	3.91	86.4	5.44	92.4	6.33	83.6	6.93	93.8	7.53	
		66.1	2.76	68.2	3.46	77.3	3.99	86.4	5.54	92.4	6.45	83.6	7.05	93.8	7.65	

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note1 : The above table shows the average value of conditions which may occur.

RXYQ108PAYD

Cooling capacity			Indoor air temp. °F/WB				Indoor air temp. °C/WB				Outdoor air temp. °F(Db)	Combi- nation (%)	Cooling capacity				
		PI	64		70		76		82				88		94		PI
TC	PI		TC	PI	TC	PI	TC	PI	TC	PI			TC	PI	TC	PI	
130	90	50	91.1	4.30	111	6.04	121	7.95	142	10.5	167	15.5	192	21.0	220	24.0	
		55	91.1	4.39	111	6.14	121	8.04	142	11.6	167	16.6	192	22.1	220	25.1	
		60	91.1	4.47	111	6.24	121	8.14	142	12.7	167	17.7	192	23.2	220	26.2	
		65	91.1	4.56	111	6.34	121	8.24	142	13.8	167	18.8	192	24.3	220	27.3	
		70	91.1	4.65	111	6.44	121	8.34	142	14.9	167	19.9	192	25.4	220	28.4	
	75	91.1	5.00	111	7.04	121	9.04	142	16.4	167	21.4	192	26.9	220	29.9		
	80	91.1	5.31	111	7.59	121	9.59	142	17.9	167	22.9	192	28.4	220	31.4		
	85	91.1	5.61	111	8.14	121	10.14	142	19.4	167	24.4	192	29.9	220	32.9		
	90	91.1	5.91	111	8.69	121	10.69	142	20.9	167	25.9	192	31.4	220	34.4		
	95	91.1	6.21	111	9.24	121	11.24	142	22.4	167	27.4	192	32.9	220	35.9		
120	80	50	84.1	3.93	102	4.90	116	6.45	133	9.55	158	14.1	183	19.1	200	21.6	
		55	84.1	4.01	102	5.01	116	6.55	133	9.65	158	14.2	183	19.2	200	21.7	
		60	84.1	4.10	102	5.11	116	6.65	133	9.75	158	14.3	183	19.3	200	21.8	
		65	84.1	4.18	102	5.21	116	6.75	133	9.85	158	14.4	183	19.4	200	21.9	
		70	84.1	4.27	102	5.31	116	6.85	133	9.95	158	14.5	183	19.5	200	22.0	
	75	84.1	4.35	102	5.41	116	6.95	133	10.05	158	14.6	183	19.6	200	22.1		
	80	84.1	4.43	102	5.51	116	7.05	133	10.15	158	14.7	183	19.7	200	22.2		
	85	84.1	4.51	102	5.61	116	7.15	133	10.25	158	14.8	183	19.8	200	22.3		
	90	84.1	4.59	102	5.71	116	7.25	133	10.35	158	14.9	183	19.9	200	22.4		
	95	84.1	4.67	102	5.81	116	7.35	133	10.45	158	15.0	183	20.0	200	22.5		
110	70	50	77.1	3.57	93.8	4.54	106	6.22	119	8.83	131	13.0	156	17.9	177	19.9	
		55	77.1	3.65	93.8	4.64	106	6.32	119	8.93	131	13.1	156	18.0	177	20.0	
		60	77.1	3.73	93.8	4.74	106	6.42	119	9.03	131	13.2	156	18.1	177	20.1	
		65	77.1	3.81	93.8	4.84	106	6.52	119	9.13	131	13.3	156	18.2	177	20.2	
		70	77.1	3.90	93.8	4.94	106	6.62	119	9.23	131	13.4	156	18.3	177	20.3	
	75	77.1	4.00	93.8	5.03	106	6.72	119	9.33	131	13.5	156	18.4	177	20.4		
	80	77.1	4.09	93.8	5.13	106	6.82	119	9.43	131	13.6	156	18.5	177	20.5		
	85	77.1	4.18	93.8	5.22	106	6.92	119	9.53	131	13.7	156	18.6	177	20.6		
	90	77.1	4.27	93.8	5.32	106	7.02	119	9.63	131	13.8	156	18.7	177	20.7		
	95	77.1	4.36	93.8	5.42	106	7.12	119	9.73	131	13.9	156	18.8	177	20.8		
100	60	50	70.1	3.21	85.2	4.23	98.8	5.22	108	10.2	124	14.0	147	18.4	164	20.4	
		55	70.1	3.29	85.2	4.33	98.8	5.32	108	10.3	124	14.1	147	18.5	164	20.5	
		60	70.1	3.37	85.2	4.43	98.8	5.42	108	10.4	124	14.2	147	18.6	164	20.6	
		65	70.1	3.45	85.2	4.53	98.8	5.52	108	10.5	124	14.3	147	18.7	164	20.7	
		70	70.1	3.53	85.2	4.63	98.8	5.62	108	10.6	124	14.4	147	18.8	164	20.8	
	75	70.1	3.61	85.2	4.73	98.8	5.72	108	10.7	124	14.5	147	18.9	164	20.9		
	80	70.1	3.70	85.2	4.83	98.8	5.82	108	10.8	124	14.6	147	19.0	164	21.0		
	85	70.1	3.78	85.2	4.93	98.8	5.92	108	10.9	124	14.7	147	19.1	164	21.1		
	90	70.1	3.86	85.2	5.03	98.8	6.02	108	11.0	124	14.8	147	19.2	164	21.2		
	95	70.1	3.95	85.2	5.13	98.8	6.12	108	11.1	124	14.9	147	19.3	164	21.3		

TC: Total capacity ; MBH

PI: Power Input ; kW (Comp.+Outdoor fan motor)

Note1: The above table shows the average value of conditions which may occur.

RXYQ144PAYD

Table with columns for Outdoor air temp., Indoor air temp., and Cooling capacity. It is organized into sections for different combinations (90, 80, 70, 60) and indoor air temperatures (64, 67, 70, 72, 75).

TC : Total capacity ; MBH
PI : Power Input ; kW (Comp.+Outdoor fan motor)
Note1 : The above table shows the average value of conditions which may occur.

RXYQ168PAYD

Cooling capacity	Outdoor air temp. (°F/DB)	Outdoor air temp. (°C)	Indoor air temp. - FWB														
			64			67			70			72			75		
			TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH
90	90	50	98.1	4.15	119	5.10	135	5.85	151	6.64	167	7.44	178	7.99	184	8.83	
		54	98.1	4.22	119	5.20	135	5.97	151	6.77	167	7.60	178	8.16	184	9.01	
		58	98.1	4.30	119	5.31	135	6.14	151	7.02	167	7.96	178	8.56	184	9.41	
		62	98.1	4.39	119	5.41	135	6.32	151	7.28	167	8.25	178	8.96	184	9.71	
		66	98.1	4.48	119	5.53	135	6.50	151	7.56	167	8.51	178	9.26	184	10.1	
		70	98.1	4.57	119	5.65	135	6.68	151	7.84	167	8.76	178	9.51	184	10.4	
		74	98.1	4.62	119	5.71	135	6.75	151	8.08	167	9.01	178	9.76	184	10.7	
		78	98.1	4.70	119	6.02	135	7.13	151	8.34	167	9.26	178	10.01	184	11.0	
		82	98.1	5.04	119	6.47	135	7.67	151	8.66	167	10.2	178	10.26	184	11.3	
		86	98.1	5.39	119	6.95	135	8.25	151	9.06	167	10.4	178	10.51	184	11.6	
		90	98.1	5.77	119	7.45	135	8.85	151	9.49	167	10.7	178	10.76	184	11.9	
		94	98.1	6.09	119	7.84	135	9.25	151	9.87	167	11.0	178	11.01	184	12.2	
98	98.1	6.39	119	8.14	135	9.54	151	10.2	167	11.2	178	11.26	184	12.5			
102	98.1	6.67	119	8.38	135	9.78	151	10.4	167	11.4	178	11.4	184	12.7			
80	80	50	88.1	3.52	106	4.50	120	5.14	134	5.81	149	6.50	158	6.92	172	7.50	
		54	87.2	3.75	106	4.58	120	5.24	134	5.93	149	6.64	158	7.12	172	7.86	
		58	87.2	3.82	106	4.67	120	5.35	134	6.05	149	6.78	158	7.27	172	8.03	
		62	87.2	3.89	106	4.76	120	5.46	134	6.18	149	6.92	158	7.43	172	8.21	
		66	87.2	3.97	106	4.86	120	5.57	134	6.31	149	7.08	158	7.60	172	8.48	
		70	87.2	4.05	106	4.96	120	5.69	134	6.45	149	7.40	158	8.08	172	8.95	
		74	87.2	4.14	106	5.07	120	5.80	134	6.59	149	7.69	158	8.38	172	9.31	
		78	87.2	4.23	106	5.17	120	5.92	134	6.73	149	7.98	158	8.68	172	9.67	
		82	87.2	4.37	106	5.25	120	6.04	134	6.87	149	8.27	158	8.97	172	10.0	
		86	87.2	4.68	106	5.56	120	6.34	134	7.17	149	8.57	158	9.27	172	10.3	
		90	87.2	5.00	106	6.08	120	7.52	134	8.77	149	10.1	158	11.1	172	12.6	
		94	87.2	5.34	106	6.82	120	8.06	134	9.41	149	11.3	158	12.3	170	13.7	
98	87.2	5.61	106	7.05	120	8.34	134	9.74	149	11.7	158	12.8	169	14.0			
102	87.2	5.89	106	7.29	120	8.63	134	10.1	149	12.5	158	13.7	166	14.6			
106	87.2	6.07	106	7.80	120	9.24	134	10.8	149	13.5	158	14.7	163	15.1			
110	87.2	6.27	106	8.33	120	9.88	134	11.6	149	14.9	158	16.1	151	16.9			
70	70	50	78.3	3.25	92.8	3.96	105	4.56	118	5.02	130	5.70	138	6.00	151	6.91	
		54	78.3	3.36	92.8	4.07	105	4.63	118	5.22	130	5.83	138	6.25	151	6.99	
		58	78.3	3.42	92.8	4.15	105	4.72	118	5.34	130	5.95	138	6.38	151	7.03	
		62	78.3	3.48	92.8	4.23	105	4.82	118	5.44	130	6.08	138	6.52	151	7.19	
		66	78.3	3.55	92.8	4.31	105	4.92	118	5.56	130	6.21	138	6.69	151	7.54	
		70	78.3	3.58	92.8	4.36	105	4.97	118	5.62	130	6.39	138	6.85	151	7.84	
		74	78.3	3.63	92.8	4.42	105	5.12	118	5.91	130	6.75	138	7.35	151	8.29	
		78	78.3	3.76	92.8	4.42	105	5.12	118	5.91	130	6.75	138	7.35	151	8.29	
		82	78.3	4.01	92.8	4.71	105	5.49	118	6.31	130	7.26	138	7.91	151	8.93	
		86	78.3	4.28	92.8	5.08	105	5.89	118	6.81	130	7.80	138	8.50	151	9.61	
		90	78.3	4.52	92.8	5.38	105	6.31	118	7.30	130	8.37	138	9.15	151	10.3	
		94	78.3	4.71	92.8	5.65	105	6.76	118	7.80	130	8.92	138	9.79	151	11.1	
98	78.3	4.96	92.8	6.15	105	7.22	118	8.37	130	9.29	138	10.1	151	11.5			
102	78.3	5.18	92.8	6.56	105	7.71	118	8.96	130	10.3	138	10.5	151	11.9			
106	78.3	5.51	92.8	7.00	105	8.24	118	9.58	130	11.0	138	11.3	151	12.8			
110	78.3	5.83	92.8	7.44	105	8.74	118	10.2	130	11.8	138	12.1	151	13.7			
60	60	50	65.4	2.83	79.6	3.38	90.2	3.81	101	4.26	111	4.74	118	5.06	129	5.66	
		54	65.4	2.88	79.6	3.44	90.2	3.88	101	4.34	111	4.83	118	5.16	129	5.67	
		58	65.4	2.92	79.6	3.50	90.2	3.95	101	4.43	111	4.92	118	5.26	129	5.78	
		62	65.4	2.97	79.6	3.56	90.2	4.03	101	4.51	111	5.02	118	5.37	129	5.91	
		66	65.4	3.02	79.6	3.62	90.2	4.10	101	4.61	111	5.13	118	5.48	129	6.03	
		70	65.4	3.10	79.6	3.73	90.2	4.23	101	4.70	111	5.26	118	5.66	129	6.33	
		74	65.4	3.14	79.6	3.78	90.2	4.29	101	4.85	111	5.31	118	5.71	129	6.69	
		78	65.4	3.20	79.6	3.93	90.2	4.55	101	5.21	111	5.51	118	6.41	129	7.73	
		82	65.4	3.40	79.6	4.20	90.2	4.87	101	5.58	111	6.34	118	6.88	129	7.73	
		86	65.4	3.62	79.6	4.49	90.2	5.20	101	5.97	111	6.80	118	7.38	129	8.29	
		90	65.4	3.86	79.6	4.79	90.2	5.56	101	6.60	111	7.53	118	8.18	129	8.89	
		94	65.4	4.10	79.6	5.10	90.2	6.02	101	7.28	111	8.46	118	9.18	129	9.53	
98	65.4	4.36	79.6	5.44	90.2	6.32	101	7.81	111	9.05	118	9.85	129	10.2			
102	65.4	4.63	79.6	5.79	90.2	6.73	101	8.30	111	9.89	118	10.8	129	10.9			

TC : Total capacity ; MBH
 PI : Power input ; kW (Comp.+Outdoor fan motor)
 Note1 : The above table shows the average value of conditions which may occur.

RXYQ192PAYD

Cooling capacity	Outdoor air temp. (°F/DB)	Indoor air temp. - FWB																		
		57			61			64			70			72			75			
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	
90	50	112	5.10	136	6.26	155	7.19	173	8.15	191	9.14	203	9.82	10.0	221	10.8	221	10.8	221	10.8
	54	112	5.19	136	6.39	155	7.34	173	8.32	191	9.34	203	10.0	221	11.1	221	11.1	221	11.1	221
	58	112	5.29	136	6.55	155	7.65	173	8.60	191	9.73	203	10.5	221	11.8	221	11.8	221	11.8	221
	62	112	5.39	136	6.79	155	7.81	173	8.82	191	9.96	203	10.8	221	12.4	221	12.4	221	12.4	221
	66	112	5.50	136	7.04	155	7.99	173	9.06	191	10.8	203	11.8	221	13.5	221	13.5	221	13.5	221
	70	112	5.67	136	7.40	155	8.29	173	9.43	191	11.2	203	12.3	221	14.7	221	14.7	221	14.7	221
	75	112	5.77	136	7.85	155	8.76	173	10.0	191	11.8	203	13.0	221	15.1	221	15.1	221	15.1	221
	79	112	5.91	136	8.26	155	9.43	173	11.0	191	12.7	203	14.0	221	16.0	221	16.0	221	16.0	221
	83	112	6.03	136	8.63	155	10.1	173	11.9	191	14.8	203	15.1	221	17.2	221	17.2	221	17.2	221
	87	112	6.18	136	9.00	155	10.9	173	12.8	191	16.6	203	16.6	221	18.1	221	18.1	221	18.1	221
80	50	112	5.10	136	6.26	155	7.19	173	8.15	191	9.14	203	9.82	10.0	221	10.8	221	10.8	221	10.8
	54	112	5.19	136	6.39	155	7.34	173	8.32	191	9.34	203	10.0	221	11.1	221	11.1	221	11.1	221
	58	112	5.29	136	6.55	155	7.65	173	8.60	191	9.73	203	10.5	221	11.8	221	11.8	221	11.8	221
	62	112	5.39	136	6.79	155	7.81	173	8.82	191	9.96	203	10.8	221	12.4	221	12.4	221	12.4	221
	66	112	5.50	136	7.04	155	7.99	173	9.06	191	10.8	203	11.8	221	13.5	221	13.5	221	13.5	221
	70	112	5.67	136	7.40	155	8.29	173	9.43	191	11.2	203	12.3	221	14.7	221	14.7	221	14.7	221
	75	112	5.77	136	7.85	155	8.76	173	10.0	191	11.8	203	13.0	221	15.1	221	15.1	221	15.1	221
	79	112	5.91	136	8.26	155	9.43	173	11.0	191	12.7	203	14.0	221	16.0	221	16.0	221	16.0	221
	83	112	6.03	136	8.63	155	10.1	173	11.9	191	14.8	203	15.1	221	17.2	221	17.2	221	17.2	221
	87	112	6.18	136	9.00	155	10.9	173	12.8	191	16.6	203	16.6	221	18.1	221	18.1	221	18.1	221
70	50	112	5.10	136	6.26	155	7.19	173	8.15	191	9.14	203	9.82	10.0	221	10.8	221	10.8	221	10.8
	54	112	5.19	136	6.39	155	7.34	173	8.32	191	9.34	203	10.0	221	11.1	221	11.1	221	11.1	221
	58	112	5.29	136	6.55	155	7.65	173	8.60	191	9.73	203	10.5	221	11.8	221	11.8	221	11.8	221
	62	112	5.39	136	6.79	155	7.81	173	8.82	191	9.96	203	10.8	221	12.4	221	12.4	221	12.4	221
	66	112	5.50	136	7.04	155	7.99	173	9.06	191	10.8	203	11.8	221	13.5	221	13.5	221	13.5	221
	70	112	5.67	136	7.40	155	8.29	173	9.43	191	11.2	203	12.3	221	14.7	221	14.7	221	14.7	221
	75	112	5.77	136	7.85	155	8.76	173	10.0	191	11.8	203	13.0	221	15.1	221	15.1	221	15.1	221
	79	112	5.91	136	8.26	155	9.43	173	11.0	191	12.7	203	14.0	221	16.0	221	16.0	221	16.0	221
	83	112	6.03	136	8.63	155	10.1	173	11.9	191	14.8	203	15.1	221	17.2	221	17.2	221	17.2	221
	87	112	6.18	136	9.00	155	10.9	173	12.8	191	16.6	203	16.6	221	18.1	221	18.1	221	18.1	221
60	50	112	5.10	136	6.26	155	7.19	173	8.15	191	9.14	203	9.82	10.0	221	10.8	221	10.8	221	10.8
	54	112	5.19	136	6.39	155	7.34	173	8.32	191	9.34	203	10.0	221	11.1	221	11.1	221	11.1	221
	58	112	5.29	136	6.55	155	7.65	173	8.60	191	9.73	203	10.5	221	11.8	221	11.8	221	11.8	221
	62	112	5.39	136	6.79	155	7.81	173	8.82	191	9.96	203	10.8	221	12.4	221	12.4	221	12.4	221
	66	112	5.50	136	7.04	155	7.99	173	9.06	191	10.8	203	11.8	221	13.5	221	13.5	221	13.5	221
	70	112	5.67	136	7.40	155	8.29	173	9.43	191	11.2	203	12.3	221	14.7	221	14.7	221	14.7	221
	75	112	5.77	136	7.85	155	8.76	173	10.0	191	11.8	203	13.0	221	15.1	221	15.1	221	15.1	221
	79	112	5.91	136	8.26	155	9.43	173	11.0	191	12.7	203	14.0	221	16.0	221	16.0	221	16.0	221
	83	112	6.03	136	8.63	155	10.1	173	11.9	191	14.8	203	15.1	221	17.2	221	17.2	221	17.2	221
	87	112	6.18	136	9.00	155	10.9	173	12.8	191	16.6	203	16.6	221	18.1	221	18.1	221	18.1	221

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note1 : The above table shows the average value of conditions which may occur.

RXYQ240PYDNR

Outdoor air temp.			Indoor air temp. °F/WB												Cooling capacity		
Combi-nation (%)	Outdoor air temp. (°F/DB)	Outdoor air temp. (°F/WB)	57		61		64		67		70		72		75		
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI			
90	50	50	140	140	140	140	140	140	140	140	140	140	140	140	140	140	
	54	54	138	138	138	138	138	138	138	138	138	138	138	138	138	138	
	58	58	136	136	136	136	136	136	136	136	136	136	136	136	136	136	
	62	62	134	134	134	134	134	134	134	134	134	134	134	134	134	134	
	66	66	132	132	132	132	132	132	132	132	132	132	132	132	132	132	
	70	70	130	130	130	130	130	130	130	130	130	130	130	130	130	130	
	75	75	128	128	128	128	128	128	128	128	128	128	128	128	128	128	
	80	80	126	126	126	126	126	126	126	126	126	126	126	126	126	126	
	85	85	124	124	124	124	124	124	124	124	124	124	124	124	124	124	
	90	90	122	122	122	122	122	122	122	122	122	122	122	122	122	122	
80	50	50	130	130	130	130	130	130	130	130	130	130	130	130	130	130	
	54	54	128	128	128	128	128	128	128	128	128	128	128	128	128	128	
	58	58	126	126	126	126	126	126	126	126	126	126	126	126	126	126	
	62	62	124	124	124	124	124	124	124	124	124	124	124	124	124	124	
	66	66	122	122	122	122	122	122	122	122	122	122	122	122	122	122	
	70	70	120	120	120	120	120	120	120	120	120	120	120	120	120	120	
	75	75	118	118	118	118	118	118	118	118	118	118	118	118	118	118	
	80	80	116	116	116	116	116	116	116	116	116	116	116	116	116	116	
	85	85	114	114	114	114	114	114	114	114	114	114	114	114	114	114	
	90	90	112	112	112	112	112	112	112	112	112	112	112	112	112	112	
70	50	50	120	120	120	120	120	120	120	120	120	120	120	120	120	120	
	54	54	118	118	118	118	118	118	118	118	118	118	118	118	118	118	
	58	58	116	116	116	116	116	116	116	116	116	116	116	116	116	116	
	62	62	114	114	114	114	114	114	114	114	114	114	114	114	114	114	
	66	66	112	112	112	112	112	112	112	112	112	112	112	112	112	112	
	70	70	110	110	110	110	110	110	110	110	110	110	110	110	110	110	
	75	75	108	108	108	108	108	108	108	108	108	108	108	108	108	108	
	80	80	106	106	106	106	106	106	106	106	106	106	106	106	106	106	
	85	85	104	104	104	104	104	104	104	104	104	104	104	104	104	104	
	90	90	102	102	102	102	102	102	102	102	102	102	102	102	102	102	
60	50	50	110	110	110	110	110	110	110	110	110	110	110	110	110	110	
	54	54	108	108	108	108	108	108	108	108	108	108	108	108	108	108	
	58	58	106	106	106	106	106	106	106	106	106	106	106	106	106	106	
	62	62	104	104	104	104	104	104	104	104	104	104	104	104	104	104	
	66	66	102	102	102	102	102	102	102	102	102	102	102	102	102	102	
	70	70	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	75	75	98	98	98	98	98	98	98	98	98	98	98	98	98	98	
	80	80	96	96	96	96	96	96	96	96	96	96	96	96	96	96	
	85	85	94	94	94	94	94	94	94	94	94	94	94	94	94	94	
	90	90	92	92	92	92	92	92	92	92	92	92	92	92	92	92	

TC: Total capacity; MBH
 PI: Power input; kW (Comp.+Outdoor fan motor)
 Note: The above table shows the average value of conditions which may occur.

Heating capacity

Combi-ratton (%)	Outdoor air temp. (°FDB)	Indoor air Temp. °FDB														
		61			65			70			72			75		
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH
70	-3.64	-4.0	56.1	7.44	56.2	7.83	56.2	7.77	56.1	7.87	56.1	7.87	56.1	7.87	56.1	7.87
	-1.84	-2.2	58.1	7.54	58.0	7.72	57.9	7.86	56.7	7.70	54.6	7.63	51.5	6.82	7.09	
	9.5	5.0	65.0	7.86	61.9	7.46	58.8	6.99	56.7	6.68	54.6	6.38	51.5	5.94		
	13.0	12.0	66.1	7.59	61.9	7.00	58.8	6.56	56.7	6.28	54.6	6.00	51.5	5.59		
	15.0	14.0	66.1	6.92	61.9	6.38	58.8	6.19	56.7	5.93	54.6	5.67	51.5	5.28		
	17.0	15.5	66.1	6.75	61.9	6.23	58.8	5.86	56.7	5.61	54.6	5.37	51.5	5.01		
	19.0	18.0	66.1	6.50	61.9	6.00	58.8	5.64	56.7	5.40	54.6	5.17	51.5	4.83		
	22.0	20.0	66.1	6.30	61.9	5.83	58.8	5.48	56.7	5.25	54.6	4.97	51.5	4.70		
	30.0	28.0	66.1	5.64	61.9	5.23	58.8	4.92	56.7	4.72	54.6	4.52	51.5	4.23		
	35.0	32.0	66.1	5.36	61.9	4.97	58.8	4.68	56.7	4.50	54.6	4.31	51.5	4.04		
	44.0	40.0	66.1	5.11	61.9	4.74	58.8	4.47	56.7	4.29	54.6	4.12	51.5	3.86		
	47.0	43.0	66.1	4.89	61.9	4.54	58.8	4.15	56.7	4.11	54.6	3.94	51.5	3.70		
51.0	47.0	66.1	4.73	61.9	4.39	58.8	4.15	56.7	4.11	54.6	3.82	51.5	3.59			
54.0	50.0	66.1	4.53	61.9	4.22	58.8	3.98	56.7	3.83	54.6	3.69	51.5	3.45			
57.0	53.0	66.1	4.40	61.9	4.09	58.8	3.87	56.7	3.72	54.6	3.57	51.5	3.36			
60.0	56.0	66.1	4.27	61.9	3.98	58.8	3.76	56.7	3.62	54.6	3.47	51.5	3.27			
			4.16	61.9	3.87	58.8	3.66	56.7	3.52	54.6	3.38	51.5	3.18			
60	-3.64	-4.0	56.1	7.87	53.1	7.37	50.4	6.91	48.6	6.61	46.8	6.31	44.1	5.88		
	-1.84	-2.2	56.7	7.70	53.1	7.09	50.4	6.65	48.6	6.37	46.8	6.09	44.1	5.67		
	9.5	5.0	56.7	6.68	53.1	6.17	50.4	5.80	48.6	5.55	46.8	5.31	44.1	4.96		
	13.0	12.0	56.7	6.28	53.1	5.81	50.4	5.46	48.6	5.23	46.8	5.01	44.1	4.68		
	15.0	14.0	56.7	5.93	53.1	5.48	50.4	5.16	48.6	4.95	46.8	4.74	44.1	4.43		
	17.0	15.5	56.7	5.74	53.1	5.31	50.4	5.00	48.6	4.80	46.8	4.60	44.1	4.30		
	19.0	18.0	56.7	5.61	53.1	5.20	50.4	4.89	48.6	4.69	46.8	4.50	44.1	4.21		
	22.0	20.0	56.7	5.40	53.1	5.01	50.4	4.72	48.6	4.53	46.8	4.34	44.1	4.07		
	26.0	24.0	56.7	5.25	53.1	4.87	50.4	4.59	48.6	4.41	46.8	4.22	44.1	3.96		
	30.0	28.0	56.7	4.97	53.1	4.61	50.4	4.35	48.6	4.18	46.8	4.01	44.1	3.76		
	35.0	32.0	56.7	4.50	53.1	4.18	50.4	3.95	48.6	3.80	46.8	3.62	44.1	3.58		
	39.0	36.0	56.7	4.29	53.1	3.99	50.4	3.78	48.6	3.63	46.8	3.49	44.1	3.28		
44.0	40.0	56.7	4.11	53.1	3.83	50.4	3.62	48.6	3.48	46.8	3.35	44.1	3.15			
47.0	43.0	56.7	3.98	53.1	3.71	50.4	3.51	48.6	3.38	46.8	3.25	44.1	3.06			
51.0	47.0	56.7	3.83	53.1	3.57	50.4	3.38	48.6	3.25	46.8	3.13	44.1	2.94			
54.0	50.0	56.7	3.72	53.1	3.47	50.4	3.28	48.6	3.16	46.8	3.04	44.1	2.87			
57.0	53.0	56.7	3.62	53.1	3.37	50.4	3.20	48.6	3.08	46.8	2.96	44.1	2.79			
60.0	56.0	56.7	3.52	53.1	3.29	50.4	3.12	48.6	3.00	46.8	2.89	44.1	2.72			

TC : Total capacity ; MBH

PI : Power input ; kW (Comp. +Outdoor fan motor)

Note1 : is shown as reference.

Note 2 : The above table shows the average value of conditions which may occur.

Heating capacity

Combi- ration (%)	Outdoor air temp. (°FDB)	Indoor air temp. °FDB												
		61			65			70			75			
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	
70	-3.64	-4.0	71.0	10.3	71.0	10.6	70.9	10.8	70.8	10.9	70.7	11.1	68.8	10.8
	-1.84	-2.2	72.4	10.4	72.3	10.7	72.1	10.9	72.1	11.0	72.0	11.2	68.6	10.6
	5.5	5.0	78.3	10.8	78.2	11.0	78.1	11.2	75.6	10.8	72.8	10.3	68.6	9.56
	9.5	8.5	81.7	10.9	81.6	11.2	78.4	10.7	75.6	10.2	72.8	9.76	68.6	9.08
	13.0	12.0	85.4	11.1	82.6	10.8	78.4	10.1	75.6	9.67	72.8	9.23	68.6	8.60
	15.0	14.0	87.7	11.2	82.6	10.4	78.4	9.78	75.6	9.36	72.8	8.94	68.6	8.33
	17.0	15.5	88.2	11.0	82.6	10.2	78.4	9.54	75.6	9.13	72.8	8.72	68.6	8.13
	19.0	18.0	88.2	10.6	82.6	9.75	78.4	9.15	75.6	8.76	72.8	8.37	68.6	7.81
	22.0	20.0	88.2	10.2	82.6	9.42	78.4	8.84	75.6	8.47	72.8	8.10	68.6	7.56
	30.0	24.0	88.2	9.52	82.6	8.79	78.4	8.26	75.6	7.92	72.8	7.58	68.6	7.07
	35.0	32.0	88.2	8.87	82.6	8.20	78.4	7.72	75.6	7.40	72.8	7.08	68.6	6.62
	39.0	36.0	88.2	8.27	82.6	7.66	78.4	7.21	75.6	6.92	72.8	6.63	68.6	6.20
44.0	40.0	88.2	7.71	82.6	7.15	78.4	6.74	75.6	6.47	72.8	6.20	68.6	5.81	
47.0	43.0	88.2	7.20	82.6	6.69	78.4	6.31	75.6	6.06	72.8	5.81	68.6	5.45	
51.0	47.0	88.2	6.85	82.6	6.36	78.4	6.00	75.6	5.77	72.8	5.54	68.6	5.20	
54.0	50.0	88.2	6.41	82.6	5.96	78.4	5.63	75.6	5.41	72.8	5.20	68.6	4.88	
57.0	53.0	88.2	6.10	82.6	5.68	78.4	5.37	75.6	5.17	72.8	4.96	68.6	4.67	
60.0	56.0	88.2	5.82	82.6	5.42	78.4	5.13	75.6	4.93	72.8	4.74	68.6	4.46	
			5.55	82.6	5.17	78.4	4.90	75.6	4.72	72.8	4.54	68.6	4.27	
60	-3.64	-4.0	70.8	10.9	70.7	11.2	67.2	10.5	64.8	10.1	62.4	9.60	58.8	8.93
	-1.84	-2.2	72.1	11.0	70.8	11.0	67.2	10.3	64.8	9.84	62.4	9.39	58.8	8.74
	5.5	5.0	75.6	10.8	70.8	9.84	67.2	9.33	64.8	8.93	62.4	8.53	58.8	7.95
	9.5	8.5	75.6	10.2	70.8	9.43	67.2	8.85	64.8	8.48	62.4	8.11	58.8	7.56
	13.0	12.0	75.6	9.67	70.8	8.93	67.2	8.39	64.8	8.03	62.4	7.69	58.8	7.18
	15.0	14.0	75.6	9.36	70.8	8.65	67.2	8.13	64.8	7.79	62.4	7.45	58.8	6.96
	17.0	15.5	75.6	9.13	70.8	8.44	67.2	7.93	64.8	7.60	62.4	7.28	58.8	6.80
	19.0	18.0	75.6	8.76	70.8	8.10	67.2	7.62	64.8	7.31	62.4	7.00	58.8	6.54
	22.0	20.0	75.6	8.47	70.8	7.84	67.2	7.38	64.8	7.07	62.4	6.78	58.8	6.34
	30.0	28.0	75.6	7.92	70.8	7.33	67.2	6.91	64.8	6.63	62.4	6.36	58.8	5.95
	35.0	32.0	75.6	7.40	70.8	6.86	67.2	6.47	64.8	6.21	62.4	5.96	58.8	5.59
	39.0	36.0	75.6	6.91	70.8	6.42	67.2	6.06	64.8	5.82	62.4	5.59	58.8	5.24
44.0	40.0	75.6	6.47	70.8	6.01	67.2	5.68	64.8	5.46	62.4	5.25	58.8	4.93	
47.0	43.0	75.6	6.06	70.8	5.64	67.2	5.33	64.8	5.13	62.4	4.93	58.8	4.63	
51.0	47.0	75.6	5.77	70.8	5.37	67.2	5.08	64.8	4.89	62.4	4.71	58.8	4.43	
54.0	50.0	75.6	5.41	70.8	5.05	67.2	4.78	64.8	4.60	62.4	4.43	58.8	4.17	
57.0	53.0	75.6	5.17	70.8	4.82	67.2	4.57	64.8	4.40	62.4	4.24	58.8	3.99	
60.0	56.0	75.6	4.93	70.8	4.61	67.2	4.37	64.8	4.21	62.4	4.06	58.8	3.83	
			4.72	70.8	4.41	67.2	4.18	64.8	4.04	62.4	3.89	58.8	3.67	

TC : Total capacity ; MBH

PI : Power input ; kW (Comp. +Outdoor fan motor)

Note1 : is shown as reference.

Note 2 : The above table shows the average value of conditions which may occur.

RXYQ108PAYD

Table with columns: Combustion (%), Outdoor air temp. (F/D), Indoor air temp. (F/D), and Heating capacity (TC, PI, MBH, kW) for 61, 65, 70, 72, 75 degrees. Includes data for 100% and 90% combustion.

Table with columns: Combustion (%), Outdoor air temp. (F/D), Indoor air temp. (F/D), and Heating capacity (TC, PI, MBH, kW) for 61, 65, 70, 72, 75 degrees. Includes data for 130%, 120%, and 110% combustion.

TC : Total capacity ; MBH
PI : Power Input ; kW (Comp.+Outdoor fan motor)
Note1 : is shown as reference.
Note 2: When selecting the unit models, avoid the Outdoor air temperature range shown by .
Note 2: The above table shows the average value of conditions which may occur.

Heating capacity

Comb- ration (%)	Outdoor air temp. (°FDB) (°FDB) (°FDB)	Indoor air temp. °FDB														
		61			65			70			72			75		
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH
70	-3.64	-4.0	74.1	10.7	73.9	11.0	73.8	11.2	73.2	11.2	70.5	10.7	66.4	9.94	9.94	9.94
	-1.84	-2.2	75.4	10.8	75.2	11.0	75.1	11.2	73.2	10.9	70.5	10.5	66.4	9.73	9.73	9.73
	5.5	5.0	81.4	11.1	80.0	11.1	75.9	10.4	73.2	9.94	70.5	9.50	66.4	8.86	8.86	8.86
	9.5	8.5	84.9	11.3	80.0	10.5	75.9	9.86	73.2	9.45	70.5	9.03	66.4	8.43	8.43	8.43
	13.0	12.0	85.4	10.8	80.0	9.85	75.9	9.35	73.2	8.96	70.5	8.57	66.4	8.00	8.00	8.00
	15.0	14.0	85.4	10.4	80.0	9.64	75.9	9.06	73.2	8.68	70.5	8.31	66.4	7.77	7.77	7.77
	17.0	15.5	85.4	10.2	80.0	9.41	75.9	8.85	73.2	8.48	70.5	8.12	66.4	7.59	7.59	7.59
	19.0	18.0	85.4	9.76	80.0	9.04	75.9	8.50	73.2	8.15	70.5	7.81	66.4	7.30	7.30	7.30
	22.0	20.0	85.4	9.45	80.0	8.74	75.9	8.23	73.2	7.90	70.5	7.57	66.4	7.08	7.08	7.08
	30.0	28.0	85.4	8.83	80.0	8.19	75.9	7.71	73.2	7.40	70.5	7.10	66.4	6.65	6.65	6.65
	35.0	32.0	85.4	8.26	80.0	7.72	75.9	7.23	73.2	6.94	70.5	6.66	66.4	6.24	6.24	6.24
	39.0	36.0	85.4	7.72	80.0	7.17	75.9	6.77	73.2	6.51	70.5	6.25	66.4	5.86	5.86	5.86
44.0	40.0	85.4	7.23	80.0	6.72	75.9	6.35	73.2	6.11	70.5	5.86	66.4	5.51	5.51	5.51	
47.0	43.0	85.4	6.77	80.0	6.30	75.9	5.96	73.2	5.73	70.5	5.51	66.4	5.18	5.18	5.18	
51.0	47.0	85.4	6.45	80.0	6.01	75.9	5.69	73.2	5.47	70.5	5.26	66.4	4.95	4.95	4.95	
54.0	50.0	85.4	6.05	80.0	5.65	75.9	5.35	73.2	5.15	70.5	4.96	66.4	4.67	4.67	4.67	
57.0	53.0	85.4	5.78	80.0	5.39	75.9	5.11	73.2	4.92	70.5	4.74	66.4	4.47	4.47	4.47	
60.0	56.0	85.4	5.52	80.0	5.15	75.9	4.89	73.2	4.71	70.5	4.54	66.4	4.28	4.28	4.28	
			5.27		4.83		4.68		4.51		4.35		4.18		4.18	

TC : Total capacity ; MBH

PI : Power input ; kW (Comp. +Outdoor fan motor)

Note1 : is shown as reference.

Note 2 : The above table shows the average value of conditions which may occur.

RXYQ144PAYD

Combit-ration (%)		Outdoor air temp. (F/°C)		Indoor air temp. °F/DB												Heating capacity													
				68		70		72		74		76		78															
				TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI														
100		-3.64	-4.0	110	130	150	170	190	210	230	250	270	290	310	330	350	370	390	410	430	450	470	490	510	530	550	560	580	600

Combit-ration (%)		Outdoor air temp. (F/°C)		Indoor air temp. °F/DB												Heating capacity													
				68		70		72		74		76		78															
				TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI														
130		-3.64	-4.0	111	131	151	171	191	211	231	251	271	291	311	331	351	371	391	411	431	451	471	491	511	531	551	571	591	611

Combit-ration (%)		Outdoor air temp. (F/°C)		Indoor air temp. °F/DB												Heating capacity													
				68		70		72		74		76		78															
				TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI														
120		-3.64	-4.0	111	131	151	171	191	211	231	251	271	291	311	331	351	371	391	411	431	451	471	491	511	531	551	571	591	611

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note1 : ■ is shown as reference.
 Note 2: The above table shows the average value of conditions which may occur.

Heating capacity

Combi-ration (%)	Outdoor air temp. (°FDB)	Indoor air temp. °FDB																	
		61			65			68			70			72			75		
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH
70	-3.64	14.7	108	15.1	108	15.4	108	15.5	108	15.5	108	15.5	108	15.7	103	14.9	103	14.6	103
	-1.84	14.8	110	15.2	110	15.5	110	15.6	110	15.6	110	15.6	110	15.7	103	14.6	103	14.6	103
	5.5	14.9	111	15.3	111	15.6	111	15.6	111	15.6	111	15.6	111	15.7	103	14.6	103	14.6	103
	9.5	15.0	112	15.4	112	15.7	112	15.7	112	15.7	112	15.7	112	15.7	103	14.6	103	14.6	103
	13.0	15.1	113	15.5	113	15.8	113	15.8	113	15.8	113	15.8	113	15.7	103	14.6	103	14.6	103
	15.0	15.2	114	15.6	114	15.9	114	15.9	114	15.9	114	15.9	114	15.7	103	14.6	103	14.6	103
	17.0	15.3	115	15.7	115	16.0	115	16.0	115	16.0	115	16.0	115	15.7	103	14.6	103	14.6	103
	19.0	15.4	116	15.8	116	16.1	116	16.1	116	16.1	116	16.1	116	15.7	103	14.6	103	14.6	103
	22.0	15.5	117	15.9	117	16.2	117	16.2	117	16.2	117	16.2	117	15.7	103	14.6	103	14.6	103
	26.0	15.6	118	16.0	118	16.3	118	16.3	118	16.3	118	16.3	118	15.7	103	14.6	103	14.6	103
	30.0	15.7	119	16.1	119	16.4	119	16.4	119	16.4	119	16.4	119	15.7	103	14.6	103	14.6	103
	35.0	15.8	120	16.2	120	16.5	120	16.5	120	16.5	120	16.5	120	15.7	103	14.6	103	14.6	103
40.0	15.9	121	16.3	121	16.6	121	16.6	121	16.6	121	16.6	121	15.7	103	14.6	103	14.6	103	
44.0	16.0	122	16.4	122	16.7	122	16.7	122	16.7	122	16.7	122	15.7	103	14.6	103	14.6	103	
47.0	16.1	123	16.5	123	16.8	123	16.8	123	16.8	123	16.8	123	15.7	103	14.6	103	14.6	103	
51.0	16.2	124	16.6	124	16.9	124	16.9	124	16.9	124	16.9	124	15.7	103	14.6	103	14.6	103	
54.0	16.3	125	16.7	125	17.0	125	17.0	125	17.0	125	17.0	125	15.7	103	14.6	103	14.6	103	
57.0	16.4	126	16.8	126	17.1	126	17.1	126	17.1	126	17.1	126	15.7	103	14.6	103	14.6	103	
60.0	16.5	127	16.9	127	17.2	127	17.2	127	17.2	127	17.2	127	15.7	103	14.6	103	14.6	103	
60	-3.64	14.7	108	15.5	108	15.4	108	15.5	108	15.5	108	15.5	108	15.7	103	14.9	103	14.6	103
	-1.84	14.8	110	15.6	110	15.6	110	15.6	110	15.6	110	15.6	110	15.7	103	14.6	103	14.6	103
	5.5	14.9	111	15.7	111	15.7	111	15.7	111	15.7	111	15.7	111	15.7	103	14.6	103	14.6	103
	9.5	15.0	112	15.8	112	15.8	112	15.8	112	15.8	112	15.8	112	15.7	103	14.6	103	14.6	103
	13.0	15.1	113	15.9	113	15.9	113	15.9	113	15.9	113	15.9	113	15.7	103	14.6	103	14.6	103
	15.0	15.2	114	16.0	114	16.0	114	16.0	114	16.0	114	16.0	114	15.7	103	14.6	103	14.6	103
	17.0	15.3	115	16.1	115	16.1	115	16.1	115	16.1	115	16.1	115	15.7	103	14.6	103	14.6	103
	19.0	15.4	116	16.2	116	16.2	116	16.2	116	16.2	116	16.2	116	15.7	103	14.6	103	14.6	103
	22.0	15.5	117	16.3	117	16.3	117	16.3	117	16.3	117	16.3	117	15.7	103	14.6	103	14.6	103
	26.0	15.6	118	16.4	118	16.4	118	16.4	118	16.4	118	16.4	118	15.7	103	14.6	103	14.6	103
	30.0	15.7	119	16.5	119	16.5	119	16.5	119	16.5	119	16.5	119	15.7	103	14.6	103	14.6	103
	35.0	15.8	120	16.6	120	16.6	120	16.6	120	16.6	120	16.6	120	15.7	103	14.6	103	14.6	103
40.0	15.9	121	16.7	121	16.7	121	16.7	121	16.7	121	16.7	121	15.7	103	14.6	103	14.6	103	
44.0	16.0	122	16.8	122	16.8	122	16.8	122	16.8	122	16.8	122	15.7	103	14.6	103	14.6	103	
47.0	16.1	123	16.9	123	16.9	123	16.9	123	16.9	123	16.9	123	15.7	103	14.6	103	14.6	103	
51.0	16.2	124	17.0	124	17.0	124	17.0	124	17.0	124	17.0	124	15.7	103	14.6	103	14.6	103	
54.0	16.3	125	17.1	125	17.1	125	17.1	125	17.1	125	17.1	125	15.7	103	14.6	103	14.6	103	
57.0	16.4	126	17.2	126	17.2	126	17.2	126	17.2	126	17.2	126	15.7	103	14.6	103	14.6	103	
60.0	16.5	127	17.3	127	17.3	127	17.3	127	17.3	127	17.3	127	15.7	103	14.6	103	14.6	103	

TC : Total capacity ; MBH

PI : Power input ; kW (Comp. +Outdoor fan motor)

Note1 : is shown as reference.

Note 2 : The above table shows the average value of conditions which may occur.

Heating capacity

Combi-ratton (%)	Outdoor air temp. (°FDB) (°FWB)	Indoor air temp. °FDB														
		61			65			70			72			75		
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH
70	-3.64	-4.0	124	18.9	123	19.1	117	17.9	113	17.1	109	16.3	102	15.2	14.9	
	-1.84	-2.2	126	19.0	123	18.7	117	17.5	113	16.7	109	16.0	102	14.9		
	5.5	5.0	132	18.3	123	16.9	117	15.8	113	15.2	109	14.5	102	13.5		
	9.5	8.5	132	17.4	123	16.0	117	15.0	113	14.4	109	13.8	102	12.8		
	13.0	12.0	132	16.4	123	15.2	117	14.2	113	13.6	109	13.1	102	12.2		
	15.0	14.0	132	15.9	123	14.7	117	13.8	113	13.2	109	12.7	102	11.8		
	17.0	15.5	132	15.5	123	14.3	117	13.5	113	12.9	109	12.4	102	11.5		
	19.0	18.0	132	14.9	123	13.8	117	12.9	113	12.4	109	11.9	102	11.1		
	22.0	20.0	132	14.4	123	13.3	117	12.5	113	12.0	109	11.5	102	10.8		
	26.0	24.0	132	13.4	123	12.4	117	11.7	113	11.2	109	10.8	102	10.1		
	30.0	28.0	132	12.5	123	11.6	117	11.0	113	10.5	109	10.1	102	9.47		
	35.0	32.0	132	11.7	123	10.9	117	10.3	113	9.87	109	9.48	102	8.89		
39.0	36.0	132	11.0	123	10.2	117	9.63	113	9.26	109	8.89	102	8.35			
44.0	40.0	132	10.3	123	9.55	117	9.03	113	8.69	109	8.35	102	7.85			
47.0	43.0	132	9.78	123	9.11	117	8.62	113	8.29	109	7.97	102	7.50			
51.0	47.0	132	9.17	123	8.55	117	8.10	113	7.80	109	7.50	102	7.07			
54.0	50.0	132	8.75	123	8.17	117	7.74	113	7.46	109	7.18	102	6.77			
57.0	53.0	132	8.36	123	7.81	117	7.40	113	7.14	109	6.87	102	6.48			
60.0	56.0	132	7.99	123	7.47	117	7.09	113	6.83	109	6.58	102	6.22			
60	-3.64	-4.0	124	18.9	123	19.1	117	17.9	113	17.1	109	16.3	102	15.2		
	-1.84	-2.2	126	19.0	123	18.7	117	17.5	113	16.7	109	16.0	102	14.9		
	5.5	5.0	132	18.3	123	16.9	117	15.8	113	15.2	109	14.5	102	13.5		
	9.5	8.5	132	17.4	123	16.0	117	15.0	113	14.4	109	13.8	102	12.8		
	13.0	12.0	132	16.4	123	15.2	117	14.2	113	13.6	109	13.1	102	12.2		
	15.0	14.0	132	15.9	123	14.7	117	13.8	113	13.2	109	12.7	102	11.8		
	17.0	15.5	132	15.5	123	14.3	117	13.5	113	12.9	109	12.4	102	11.5		
	19.0	18.0	132	14.9	123	13.8	117	12.9	113	12.4	109	11.9	102	11.1		
	22.0	20.0	132	14.4	123	13.3	117	12.5	113	12.0	109	11.5	102	10.8		
	26.0	24.0	132	13.4	123	12.4	117	11.7	113	11.2	109	10.8	102	10.1		
	30.0	28.0	132	12.5	123	11.6	117	11.0	113	10.5	109	10.1	102	9.47		
	35.0	32.0	132	11.7	123	10.9	117	10.3	113	9.87	109	9.48	102	8.89		
39.0	36.0	132	11.0	123	10.2	117	9.63	113	9.26	109	8.89	102	8.35			
44.0	40.0	132	10.3	123	9.55	117	9.03	113	8.69	109	8.35	102	7.85			
47.0	43.0	132	9.78	123	9.11	117	8.62	113	8.29	109	7.97	102	7.50			
51.0	47.0	132	9.17	123	8.55	117	8.10	113	7.80	109	7.50	102	7.07			
54.0	50.0	132	8.75	123	8.17	117	7.74	113	7.46	109	7.18	102	6.77			
57.0	53.0	132	8.36	123	7.81	117	7.40	113	7.14	109	6.87	102	6.48			
60.0	56.0	132	7.99	123	7.47	117	7.09	113	6.83	109	6.58	102	6.22			

TC : Total capacity ; MBH

PI : Power input ; kW (Comp. +Outdoor fan motor)

Note1 : is shown as reference.

When selecting the unit models, avoid the Outdoor air temperature range shown by .

Note 2 :The above table shows the average value of conditions which may occur.

RXYQ192PAYD

Combit-nation (%)	Outdoor air temp. (°F/°C)	Indoor air temp. °F/DB										Indoor air temp. °F/DB																
		61					65					70					72					75						
		TC	PI	MBH	KW	PI	TC	PI	MBH	KW	PI	TC	PI	MBH	KW	PI	TC	PI	MBH	KW	PI	TC	PI	MBH	KW	PI		
100	-3.64	4.0	144	17.0	17.8	143	18.4	142	19.4	142	19.8	142	20.1	142	20.7	144	20.2	144	20.2	144	20.8	141	21.1	141	21.6	142	20.7	
	-1.84	1.43	148	17.2	18.0	146	18.6	145	19.6	145	20.4	156	20.7	156	21.0	156	21.7	156	22.0	156	22.3	157	22.5	157	22.8	157	23.1	
	0.5	5.5	158	18.2	19.8	167	19.9	167	20.5	167	21.1	170	21.7	170	22.4	170	23.1	170	23.4	170	23.7	171	24.0	171	24.3	171	24.6	
	13.0	12.0	172	19.2	19.8	172	19.8	171	20.6	171	20.6	171	21.4	175	21.9	175	22.2	175	22.4	175	22.4	175	22.2	176	22.2	176	22.2	
	15.0	14.0	179	19.5	176	176	20.3	180	20.3	180	20.3	180	20.3	180	20.3	180	20.3	180	20.3	180	20.3	180	20.3	180	20.3	180	20.3	
	19.0	18.0	187	20.0	187	20.0	186	20.6	186	21.1	186	21.1	186	21.1	186	21.1	186	21.1	186	21.1	186	21.1	186	21.1	186	21.1	186	21.1
	22.0	20.0	192	20.3	191	20.3	191	21.3	191	21.3	191	21.3	191	21.3	191	21.3	191	21.3	191	21.3	191	21.3	191	21.3	191	21.3	191	21.3
	30.0	28.0	202	21.8	214	21.8	214	22.2	214	22.2	214	22.2	214	22.2	214	22.2	214	22.2	214	22.2	214	22.2	214	22.2	214	22.2	214	22.2
	35.0	32.0	228	22.8	228	23.3	228	23.3	228	23.3	228	23.3	228	23.3	228	23.3	228	23.3	228	23.3	228	23.3	228	23.3	228	23.3	228	23.3
	40.0	36.0	248	24.2	248	24.8	248	25.4	248	25.4	248	25.4	248	25.4	248	25.4	248	25.4	248	25.4	248	25.4	248	25.4	248	25.4	248	25.4
90	-3.64	4.0	143	18.2	143	18.9	142	19.4	142	19.8	142	20.1	142	20.7	144	20.2	144	20.2	144	20.2	144	20.8	141	21.1	141	21.6	142	20.7
	-1.84	1.43	148	18.4	145	19.1	145	19.6	145	20.4	156	20.7	156	21.0	156	21.7	156	22.0	156	22.3	157	22.5	157	22.8	157	23.1	157	23.4
	0.5	5.5	157	19.3	157	19.9	157	20.4	157	21.1	163	21.7	163	22.4	163	23.1	163	23.4	163	23.7	163	24.0	164	24.3	164	24.6	164	24.9
	13.0	12.0	172	20.4	176	21.0	176	21.6	176	22.1	176	22.6	176	23.1	176	23.6	176	24.1	176	24.4	176	24.7	177	25.0	177	25.3	177	25.6
	15.0	14.0	180	20.6	179	21.2	179	21.6	179	21.6	179	21.6	179	21.6	179	21.6	179	21.6	179	21.6	179	21.6	179	21.6	179	21.6	179	21.6
	19.0	18.0	186	20.9	185	21.5	185	21.9	185	22.2	185	22.2	185	22.2	185	22.2	185	22.2	185	22.2	185	22.2	185	22.2	185	22.2	185	22.2
	22.0	20.0	191	21.2	191	21.7	191	22.1	191	22.1	191	22.1	191	22.1	191	22.1	191	22.1	191	22.1	191	22.1	191	22.1	191	22.1	191	22.1
	30.0	28.0	202	22.1	202	22.2	202	22.5	202	22.5	202	22.5	202	22.5	202	22.5	202	22.5	202	22.5	202	22.5	202	22.5	202	22.5	202	22.5
	35.0	32.0	227	22.6	227	22.6	227	22.6	227	22.6	227	22.6	227	22.6	227	22.6	227	22.6	227	22.6	227	22.6	227	22.6	227	22.6	227	22.6
	40.0	36.0	257	23.9	257	24.5	257	25.1	257	25.1	257	25.1	257	25.1	257	25.1	257	25.1	257	25.1	257	25.1	257	25.1	257	25.1	257	25.1
80	-3.64	4.0	142	19.4	142	20.1	142	20.5	142	20.9	142	21.3	142	21.7	142	22.1	142	22.5	142	22.9	142	23.3	142	23.7	142	24.1	142	24.5
	-1.84	1.43	148	19.6	144	20.2	144	20.7	144	21.1	144	21.5	144	21.9	144	22.3	144	22.7	144	23.1	144	23.5	144	23.9	144	24.3	144	24.7
	0.5	5.5	157	20.4	156	21.0	156	21.4	156	21.8	156	22.2	156	22.6	156	23.0	156	23.4	156	23.8	156	24.2	156	24.6	156	25.0	156	25.4
	13.0	12.0	171	21.2	171	21.6	171	22.0	171	22.4	171	22.8	171	23.2	171	23.6	171	24.0	171	24.4	171	24.8	171	25.2	171	25.6	171	26.0
	15.0	14.0	179	21.6	179	22.0	179	22.4	179	22.8	179	23.2	179	23.6	179	24.0	179	24.4	179	24.8	179	25.2	179	25.6	179	26.0	179	26.4
	19.0	18.0	185	21.9	185	22.3	185	22.7	185	23.1	185	23.5	185	23.9	185	24.3	185	24.7	185	25.1	185	25.5	185	25.9	185	26.3	185	26.7
	22.0	20.0	190	22.1	189	22.3	189	22.3	189	22.3	189	22.3	189	22.3	189	22.3	189	22.3	189	22.3	189	22.3	189	22.3	189	22.3	189	22.3
	30.0	28.0	202	22.1	189	22.3	189	22.3	189	22.3	189	22.3	189	22.3	189	22.3	189	22.3	189	22.3	189	22.3	189	22.3	189	22.3	189	22.3
	35.0	32.0	227	22.6	202	22.6	202	22.6	202	22.6	202	22.6	202	22.6	202	22.6	202	22.6	202	22.6	202	22.6	202	22.6	202	22.6	202	22.6
	40.0	36.0	257	23.9	202	23.9	202	23.9	202	23.9	202	23.9	202	23.9	202	23.9	202	23.9	202	23.9	202	23.9	202	23.9	202	23.9	202	23.9

TC: Total capacity; MBH
 PI: Power Input; kW (Comp.+Outdoor fan motor)
 Note1: [Grey box] is shown as reference.
 Note 2: The above table shows the average value of conditions which may occur.

Heating capacity

Combi-ratlon (%)	Outdoor air temp. (°FDB)	Indoor air temp. °FDB																		
		61			65			68			70			72			75			
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	
70	-3.64	-4.0	141	20.7	141	21.2	141	21.6	141	21.9	141	22.2	141	22.2	137	21.7	137	21.2	137	21.2
	-1.84	-2.2	144	20.8	144	21.4	144	21.8	143	22.0	143	22.3	143	22.3	137	21.2	137	21.2	137	21.2
	5.5	5.0	156	21.5	156	22.0	155	22.4	151	21.7	146	20.7	146	20.7	137	21.2	137	21.2	137	21.2
	9.5	8.5	163	21.9	162	22.3	157	21.5	151	20.6	146	19.6	146	19.6	137	21.2	137	21.2	137	21.2
	13.0	12.0	170	22.2	165	21.7	157	20.3	151	19.4	146	18.6	137	17.3	17.3	17.3	17.3	17.3	17.3	17.3
	15.0	14.0	175	22.4	165	21.0	157	19.7	151	18.8	146	18.0	137	16.7	16.7	16.7	16.7	16.7	16.7	16.7
	17.0	15.5	176	22.2	165	20.4	157	19.2	151	18.3	146	17.5	137	16.3	16.3	16.3	16.3	16.3	16.3	16.3
	19.0	18.0	176	21.2	165	19.6	157	18.4	151	17.6	146	16.8	137	15.7	15.7	15.7	15.7	15.7	15.7	15.7
	22.0	20.0	176	20.5	165	18.9	157	17.8	151	17.0	146	16.3	137	15.2	15.2	15.2	15.2	15.2	15.2	15.2
	26.0	24.0	176	19.1	165	17.7	157	16.6	151	15.9	146	15.2	137	14.2	14.2	14.2	14.2	14.2	14.2	14.2
	30.0	28.0	176	17.8	165	16.5	157	15.5	151	14.9	146	14.2	137	13.3	13.3	13.3	13.3	13.3	13.3	13.3
	35.0	32.0	176	16.6	165	15.4	157	14.5	151	13.9	146	13.3	137	12.4	12.4	12.4	12.4	12.4	12.4	12.4
39.0	36.0	176	15.5	165	14.4	157	13.5	151	13.0	146	12.4	137	11.7	11.7	11.7	11.7	11.7	11.7	11.7	
44.0	40.0	176	14.5	165	13.4	157	12.7	151	12.2	146	11.7	137	10.9	10.9	10.9	10.9	10.9	10.9	10.9	
47.0	43.0	176	13.7	165	12.8	157	12.0	151	11.6	146	11.1	137	10.4	10.4	10.4	10.4	10.4	10.4	10.4	
51.0	47.0	176	12.9	165	12.0	157	11.3	151	10.9	146	10.4	137	9.80	9.80	9.80	9.80	9.80	9.80	9.80	
54.0	50.0	176	12.2	165	11.4	157	10.8	151	10.4	146	9.95	137	9.36	9.36	9.36	9.36	9.36	9.36	9.36	
57.0	53.0	176	11.7	165	10.9	157	10.3	151	9.89	146	9.51	137	8.95	8.95	8.95	8.95	8.95	8.95	8.95	
60.0	56.0	176	11.1	165	10.4	157	9.82	151	9.45	146	9.09	137	8.56	8.56	8.56	8.56	8.56	8.56	8.56	
60	-3.64	-4.0	141	21.9	141	22.4	134	21.2	130	20.2	125	19.3	118	18.0	18.0	18.0	18.0	18.0	18.0	18.0
	-1.84	-2.2	143	22.0	142	22.1	134	20.7	130	19.8	125	18.9	118	17.6	17.6	17.6	17.6	17.6	17.6	17.6
	5.5	5.0	151	21.7	142	20.0	134	18.8	130	18.0	125	17.2	118	16.0	16.0	16.0	16.0	16.0	16.0	16.0
	9.5	8.5	151	20.6	142	19.0	134	17.8	130	17.0	125	16.3	118	15.2	15.2	15.2	15.2	15.2	15.2	15.2
	13.0	12.0	151	19.4	142	17.9	134	16.9	130	16.2	125	15.5	118	14.4	14.4	14.4	14.4	14.4	14.4	14.4
	15.0	14.0	151	18.8	142	17.4	134	16.3	130	15.6	125	15.0	118	14.0	14.0	14.0	14.0	14.0	14.0	14.0
	17.0	15.5	151	18.3	142	17.0	134	15.9	130	15.3	125	14.6	118	13.7	13.7	13.7	13.7	13.7	13.7	13.7
	19.0	18.0	151	17.6	142	16.3	134	15.3	130	14.7	125	14.1	118	13.1	13.1	13.1	13.1	13.1	13.1	13.1
	22.0	20.0	151	17.0	142	15.7	134	14.8	130	14.2	125	13.6	118	12.7	12.7	12.7	12.7	12.7	12.7	12.7
	26.0	24.0	151	15.9	142	14.7	134	13.9	130	13.3	125	12.8	118	11.9	11.9	11.9	11.9	11.9	11.9	11.9
	30.0	28.0	151	14.9	142	13.8	134	13.0	130	12.5	125	12.0	118	11.2	11.2	11.2	11.2	11.2	11.2	11.2
	35.0	32.0	151	13.9	142	12.9	134	12.2	130	11.7	125	11.2	118	10.5	10.5	10.5	10.5	10.5	10.5	10.5
39.0	36.0	151	13.0	142	12.1	134	11.4	130	11.0	125	10.5	118	9.88	9.88	9.88	9.88	9.88	9.88	9.88	
44.0	40.0	151	12.1	142	11.3	134	10.7	130	10.3	125	9.44	118	8.88	8.88	8.88	8.88	8.88	8.88	8.88	
47.0	43.0	151	11.6	142	10.8	134	10.2	130	9.82	125	9.44	118	8.88	8.88	8.88	8.88	8.88	8.88	8.88	
51.0	47.0	151	10.9	142	10.1	134	9.59	130	9.23	125	8.94	118	8.37	8.37	8.37	8.37	8.37	8.37	8.37	
54.0	50.0	151	10.4	142	9.67	134	9.16	130	8.83	125	8.50	118	8.01	8.01	8.01	8.01	8.01	8.01	8.01	
57.0	53.0	151	9.89	142	9.24	134	8.76	130	8.45	125	8.13	118	7.67	7.67	7.67	7.67	7.67	7.67	7.67	
60.0	56.0	151	9.45	142	8.84	134	8.39	130	8.09	125	7.79	118	7.36	7.36	7.36	7.36	7.36	7.36	7.36	

TC : Total capacity ; MBH

PI : Power input ; kW (Comp. +Outdoor fan motor)

Note1 : is shown as reference.

Note 2 : The above table shows the average value of conditions which may occur.

Heating capacity

Comb- ration (%)	Outdoor air temp.		Indoor air Temp. F/DB																																																																																																																																																																																																																																																						
			61			65			68			70			72			75																																																																																																																																																																																																																																							
			TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH																																																																																																																																																																																																																																					
70	-3.64	-4.0	147	20.7	21.3	146	21.8	146	22.1	146	22.3	140	22.3	132	20.8	-1.84	-2.2	149	22.3	148	22.8	146	23.2	146	23.3	140	23.3	132	20.8	5.5	5.0	161	22.9	159	23.1	151	21.7	146	20.7	140	19.8	132	18.5	9.5	8.5	168	23.3	159	23.7	151	20.6	146	19.7	140	19.6	132	18.5	13.0	12.0	176	22.4	168	22.6	168	22.6	168	22.6	161	22.7	161	22.7	154	20.0	15.0	14.0	176	22.4	176	22.9	176	23.3	170	22.4	164	21.4	164	21.4	154	20.0	19.0	18.0	184	22.7	181	23.2	176	22.7	170	21.7	164	20.7	164	20.7	154	19.3	22.0	20.0	187	23.3	186	23.6	176	22.1	170	21.2	164	20.2	164	20.2	154	18.9	30.0	28.0	188	20.5	186	20.4	176	19.1	170	18.3	164	17.6	164	17.6	154	17.5	35.0	32.0	188	19.1	186	19.0	176	17.9	170	17.1	164	16.4	164	16.4	154	16.4	44.0	40.0	188	17.8	186	17.6	176	16.7	170	16.0	164	15.3	164	15.3	154	15.3	47.0	43.0	188	16.6	186	16.5	176	15.6	170	14.8	164	14.3	164	14.3	154	14.3	51.0	47.0	188	15.8	186	15.7	176	14.7	170	13.9	164	13.4	164	13.4	154	13.4	54.0	50.0	188	14.8	186	14.7	176	13.9	170	13.0	164	12.5	164	12.5	154	12.5	57.0	53.0	188	13.4	186	13.1	176	12.4	170	11.5	164	10.9	164	10.9	154	10.9	60.0	56.0	188	12.8	186	11.9	176	11.3	170	10.9	164	10.5	164	10.5	154	10.5
	60	-3.64	-4.0	146	22.1	146	22.7	146	23.1	146	23.3	140	23.3	132	20.8	-1.84	-2.2	149	22.3	148	22.8	146	23.2	146	23.3	140	23.3	132	20.8	5.5	5.0	161	22.9	159	23.1	151	21.7	146	20.7	140	19.8	132	18.5	9.5	8.5	168	23.3	159	23.7	151	20.6	146	19.7	140	19.6	132	18.5	13.0	12.0	176	22.4	176	22.9	176	23.3	170	22.4	164	21.4	164	21.4	154	20.0	15.0	14.0	176	22.4	181	23.2	176	22.7	170	21.7	164	20.7	164	20.7	154	19.3	19.0	18.0	184	22.7	181	23.2	176	22.1	170	21.2	164	20.2	164	20.2	154	18.9	22.0	20.0	187	23.3	186	23.6	176	22.1	170	21.2	164	20.2	164	20.2	154	18.9	30.0	28.0	188	20.5	186	20.4	176	19.1	170	18.3	164	17.6	164	17.6	154	17.5	35.0	32.0	188	19.1	186	19.0	176	17.9	170	17.1	164	16.4	164	16.4	154	16.4	44.0	40.0	188	17.8	186	17.6	176	16.7	170	16.0	164	15.3	164	15.3	154	15.3	47.0	43.0	188	16.6	186	16.5	176	15.6	170	14.8	164	14.3	164	14.3	154	14.3	51.0	47.0	188	15.8	186	15.7	176	14.7	170	13.9	164	13.4	164	13.4	154	13.4	54.0	50.0	188	14.8	186	14.7	176	13.9	170	13.0	164	12.5	164	12.5	154	12.5	57.0	53.0	188	13.4	186	13.1	176	12.4	170	11.5	164	10.9	164	10.9	154	10.9	60.0	56.0	188	12.8	186	11.9	176	11.3	170	10.9	164	10.5	164	10.5	154	10.5
		50	-3.64	-4.0	142	22.6	133	20.9	126	19.6	122	18.8	117	18.0	110	16.8	-1.84	-2.2	142	22.1	133	20.4	126	19.2	122	18.4	117	17.6	110	16.4	5.5	5.0	142	20.0	133	18.5	126	17.5	122	16.7	117	16.0	110	15.0	9.5	8.5	142	19.0	133	17.6	126	16.6	122	15.9	117	15.3	110	14.3	13.0	12.0	142	18.0	133	16.7	126	15.8	122	15.1	117	14.5	110	13.6	17.0	15.5	142	17.3	133	15.8	126	14.9	122	14.3	117	13.8	110	12.6	19.0	18.0	142	16.4	133	15.2	126	14.4	122	13.8	117	13.2	110	12.4	22.0	20.0	142	15.9	133	14.8	126	13.9	122	13.4	117	12.8	110	12.0	26.0	24.0	142	14.9	133	13.8	126	13.1	122	12.6	117	12.1	110	11.3	30.0	28.0	142	13.9	133	13.0	126	12.3	122	11.8	117	11.3	110	10.7	35.0	32.0	142	13.1	133	12.2	126	11.5	122	11.1	117	10.7	110	10.0	44.0	40.0	142	12.3	133	11.4	126	10.8	122	10.4	117	10.0	110	9.46	47.0	43.0	142	11.5	133	10.7	126	10.2	122	9.82	117	9.46	110	8.92	51.0	47.0	142	11.0	133	10.3	126	9.74	122	9.38	117	9.05	110	8.54	54.0	50.0	142	10.3	133	9.55	126	9.79	122	9.42	117	9.18	110	7.74	57.0	53.0	142	9.87	133	9.35	126	9.42	122	9.14	117	8.75	110	7.43	60.0	56.0	142	9.05	133	8.49	126	8.42	122	8.14	117	7.81	110	7.14									

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note1 : is shown as reference
 When selecting the unit models, avoid the Outdoor air temperature range shown by .

Heating capacity


Combi-ratton (%)	Outdoor air temp. (F/D)	Indoor air Temp. F/DB																		
		61			65			68			70			72			75			
		TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	
70	-3.64	-4.0	152	20.5	21.2	151	21.7	151	22.1	150	23.2	150	23.5	153	23.6	153	23.9	147	23.1	190
	-1.84	-2.2	154	20.7	21.4	154	21.9	153	22.3	153	23.6	154	23.9	156	24.0	162	23.5	156	22.5	147
	0.5	0.6	157	21.0	21.7	156	22.1	156	22.5	156	23.8	157	24.1	160	166	24.2	160	23.0	147	189
	1.3	1.4	160	21.3	22.0	159	22.4	159	22.8	159	24.1	162	20.2	156	20.2	156	19.6	147	183	179
	1.7	1.8	163	21.6	22.3	162	22.7	161	23.1	161	24.4	164	20.5	156	20.5	156	19.2	147	179	179
	1.9	2.0	166	21.9	22.6	165	23.0	164	23.4	164	24.7	167	20.4	156	20.4	156	18.8	147	172	172
	2.2	2.3	169	22.2	22.9	168	23.3	167	23.7	167	25.0	170	20.3	156	20.3	156	18.2	147	167	167
	2.6	2.7	172	22.5	23.2	171	23.6	170	24.0	170	25.3	173	20.2	156	20.2	156	17.6	147	162	162
	3.0	3.1	175	22.8	23.5	174	23.9	173	24.3	173	25.6	176	20.1	156	20.1	156	17.0	147	157	157
	3.5	3.6	178	23.1	23.8	177	24.2	176	24.6	176	25.9	179	20.0	156	20.0	156	16.4	147	152	152
	4.0	4.1	181	23.4	24.1	180	24.5	179	24.9	179	26.2	182	19.9	156	19.9	156	15.8	147	147	147
	4.6	4.7	184	23.7	24.4	183	24.8	182	25.2	182	26.5	185	19.8	156	19.8	156	15.2	147	142	142
60	-3.64	-4.0	151	22.1	22.7	150	22.7	150	23.2	150	23.5	153	23.6	153	23.9	147	23.1	190	190	
	-1.84	-2.2	153	22.3	23.0	153	23.3	153	23.8	154	24.1	160	23.5	156	24.0	162	23.5	156	22.5	147
	0.5	0.6	156	22.6	23.3	156	23.6	156	24.1	156	24.4	163	23.4	156	23.4	160	23.0	147	189	
	1.3	1.4	159	22.9	23.6	159	23.9	159	24.4	159	24.7	164	23.3	156	23.3	160	22.9	147	183	
	1.7	1.8	162	23.2	23.9	162	24.1	162	24.6	162	24.9	165	23.2	156	23.2	160	22.8	147	179	
	1.9	2.0	165	23.5	24.2	165	24.4	165	24.9	165	25.2	168	23.1	156	23.1	160	22.7	147	179	
	2.2	2.3	168	23.8	24.5	168	24.7	168	25.2	168	25.5	171	23.0	156	23.0	160	22.6	147	172	
	2.6	2.7	171	24.1	24.8	171	24.9	171	25.4	171	25.7	174	22.9	156	22.9	160	22.5	147	167	
	3.0	3.1	174	24.4	25.1	174	25.2	174	25.7	174	26.0	177	22.8	156	22.8	160	22.4	147	162	
	3.5	3.6	177	24.7	25.4	177	25.5	177	26.0	177	26.3	180	22.7	156	22.7	160	22.3	147	156	
	4.0	4.1	180	25.0	25.7	180	25.8	180	26.3	180	26.6	183	22.6	156	22.6	160	22.2	147	152	
	4.6	4.7	183	25.3	26.0	183	26.1	183	26.6	183	26.9	186	22.5	156	22.5	160	22.1	147	147	
50	-3.64	-4.0	150	23.7	24.3	147	23.7	147	24.2	147	24.7	147	24.7	147	24.7	147	24.7	147	24.7	147
	-1.84	-2.2	153	23.8	24.4	147	23.8	147	24.3	147	24.8	147	24.8	147	24.8	147	24.8	147	24.8	147
	0.5	0.6	157	24.0	24.6	147	24.0	147	24.5	147	25.0	147	24.5	147	24.5	147	24.5	147	24.5	147
	1.3	1.4	160	24.1	24.7	147	24.1	147	24.6	147	25.1	147	24.6	147	24.6	147	24.6	147	24.6	147
	1.7	1.8	163	24.2	24.8	147	24.2	147	24.7	147	25.2	147	24.7	147	24.7	147	24.7	147	24.7	147
	1.9	2.0	166	24.3	24.9	147	24.3	147	24.8	147	25.3	147	24.8	147	24.8	147	24.8	147	24.8	147
	2.2	2.3	169	24.4	25.0	147	24.4	147	24.9	147	25.4	147	24.9	147	24.9	147	24.9	147	24.9	147
	2.6	2.7	172	24.5	25.1	147	24.5	147	25.0	147	25.5	147	24.9	147	24.9	147	24.9	147	24.9	147
	3.0	3.1	175	24.6	25.2	147	24.6	147	25.1	147	25.6	147	24.9	147	24.9	147	24.9	147	24.9	147
	3.5	3.6	178	24.7	25.3	147	24.7	147	25.2	147	25.7	147	24.9	147	24.9	147	24.9	147	24.9	147
	4.0	4.1	181	24.8	25.4	147	24.8	147	25.3	147	25.8	147	24.9	147	24.9	147	24.9	147	24.9	147
	4.6	4.7	184	24.9	25.5	147	24.9	147	25.4	147	25.9	147	24.9	147	24.9	147	24.9	147	24.9	147

TC : Total capacity ; MBH
 PI : Power Input ; kW (Comp.+Outdoor fan motor)
 Note1 : is shown as reference
 When selecting the unit models, avoid the Outdoor air temperature range shown by


9.3 Capacity Correction Factor

RXYQ72PAYD

2. Rate of change in heating capacity

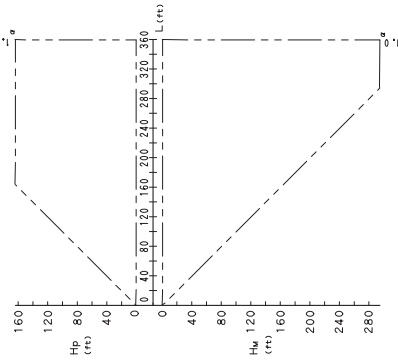

1. Rate of change in cooling capacity

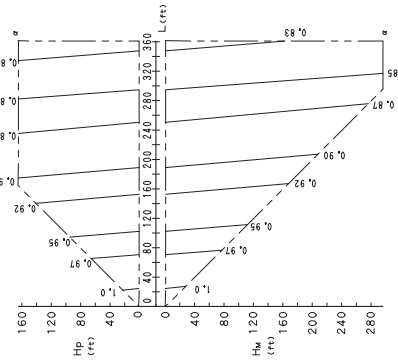

[Explanation of symbols]
 Hp : Level difference (ft) between indoor and outdoor units where indoor unit is inferior position
 Hw : Level difference (ft) between indoor and outdoor units where indoor unit is superior position
 L : Equivalent pipe length (ft)
 α : Rate of change in cooling / heating capacity
 [Diameter of the main pipes (standard size)]

Model	gas	liquid
RXYQ72PAYD	φ 3/4	φ 3/8

[Temper grade and Thickness]

Temper grade	0 Type	1/2H Type
Outer diameter	φ 3/8	φ 1/2
Minimum Wall Thickness	0.80	0.80
	0.80	0.80

Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 • Condition: Indoor unit combination ratio does not exceed 100%.
 Maximum A/C capacity of outdoor units = A/C capacity of outdoor units obtained from capacity characteristic table at the 100% combination
 x [Capacity change rate due to piping length to the farthest indoor unit]
- Condition: Indoor unit combination ratio exceeds 100%.
 Maximum A/C capacity of outdoor units = A/C capacity of outdoor units obtained from capacity characteristic table at the combination
 x [Capacity change rate due to piping length to the farthest indoor unit]
- When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]


Model	gas	liquid
RXYQ72PAYD	φ 1/8	φ 1/2

5. Read cooling / heating capacity rate of change in the above figures based on the following equivalent length,

Overall equivalent length = (Equivalent length to main pipe) x Correction factor + (Equivalent length after branching)

Choose a correction factor from the following table.
 When cooling capacity is calculated: gas pipe size
 When heating capacity is calculated: liquid pipe size

Rate of change (object piping)	Correction factor
Cooling (Gas Pipe)	1.0
Heating (Liquid Pipe)	0.5
	1.0
	0.2

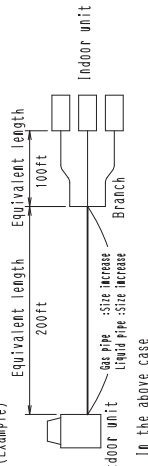


In the above case
 (Cooling) Overall equivalent length = 200ft x 0.5 + 100ft = 200ft
 (Heating) Overall equivalent length = 200ft x 0.2 + 100ft = 140ft
 The rate of change in cooling capacity when Hp=0ft is thus approximately 0.86
 heating capacity when Hp=0ft is thus approximately 1.0

C: 3D058623A

RXYQ96PAYD

2. Rate of change in heating capacity

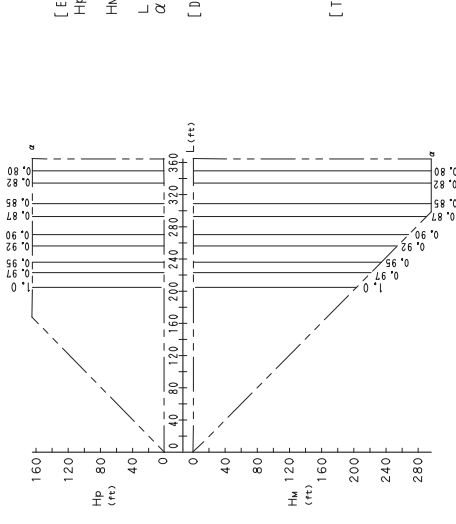

[Explanation of symbols]
 Hp : Level difference(ft)between indoor and outdoor units where indoor unit in inferior position
 Hw : Level difference(ft)between indoor and outdoor units where indoor unit in superior position
 L : Equivalent Pipe length(ft)
 α : Rate of change in cooling / heating Capacity
 [Diameter of the main pipes(standard size)]

Model	gas	liquid
RXYQ96PAYD	φ 7/8	φ 3/8

[Temper grade and Thickness]

Temper grade	□ Type	1/2H Type
Outer diameter	φ 3/8	φ 1/2
Min. mm Wall Thickness	0.80	0.80
		0.80
		0.88

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 • Condition: Indoor unit combination ratio does not exceed 100%.

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}}{\text{X [Capacity change rate due to piping length to the farthest indoor unit]}}$$
 • Condition: Indoor unit combination ratio exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{X [Capacity change rate due to piping length to the farthest indoor unit]}}$$
 • Condition: Capacity change rate due to piping length to the farthest indoor unit exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}}{\text{X [Capacity change rate due to piping length to the farthest indoor unit]}}$$
- When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]


Model	gas	liquid
RXYQ96PAYD	φ 1	φ 1/2

- Read cooling / heating capacity rate of change in the above figures based on the following equivalent length,
 Overall equivalent length = (Equivalent length to main pipe) × Correction factor + (Equivalent length after branching)

Choose a correction factor from the following table.
 When cooling capacity is calculated: gas pipe size
 When heating capacity is calculated: liquid pipe size

Rate of change (Object piping)	Correction Factor
Cooling (gas pipe)	1.0
Heating (liquid pipe)	0.5
	1.0
	0.2


(Example)

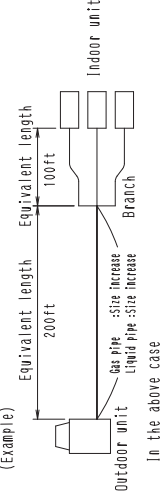


The rate of change in cooling capacity when Hp=0ft is thus approximately 0.87 heating capacity when Hp=0ft is thus approximately 1.0

RXYQ108, 144PAYD

1. Rate of change in cooling capacity

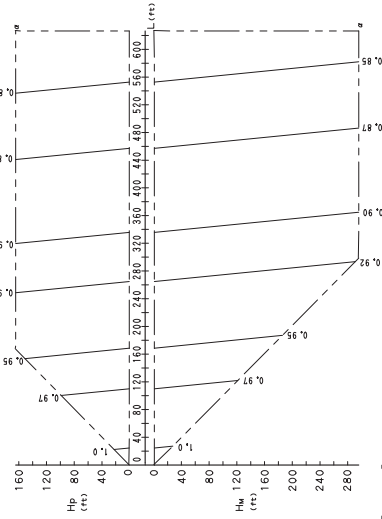

2. Rate of change in heating capacity

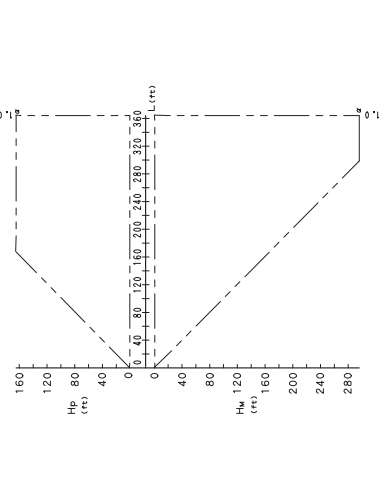

[Explanation of symbols]
 Hp : Level difference between indoor and outdoor units where indoor unit in inferior position
 Hw : Level difference between indoor and outdoor units where indoor unit in superior position
 L : Equivalent pipe length (ft)
 α : Rate of change in cooling / heating capacity [Diameter of the main pipes (standard size)]

Model	gas	liquid
RXYQ108, 144PAYD	φ 1-1/8	φ 1/2

[Temper grade and Thickness]

Temper grade	□ Type	1/2H Type
Outer diameter	φ 1/2	φ 5/8
Minimum Wall Thickness	0.80	0.99
	φ 1-1/8	φ 1-3/8
	0.80	0.80
	0.80	0.99
	1.21	1.21

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity: The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 • Condition: Indoor unit combination ratio does not exceed 100%.

$$\frac{\text{Maximum A/C capacity of outdoor units}}{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}} \times \text{Capacity change rate due to piping length to the farthest indoor unit}$$
 • Condition: Indoor unit combination ratio exceeds 100%.

$$\frac{\text{Maximum A/C capacity of outdoor units}}{\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}} \times \text{Capacity change rate due to piping length to the farthest indoor unit}$$


4. When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased. When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased. [Diameter of above case]

Model	gas	liquid
RXYQ108, 144PAYD	Not increased	φ 5/8

Overall equivalent length = (Equivalent length to main pipe) × Correction factor + (Equivalent length after branching)

Choose a correction factor from the following table.
 [When cooling capacity is calculated: gas pipe size
 [When heating capacity is calculated: liquid pipe size

Rate of change (object piping)	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	1.20 ~ 1.44
Heating (liquid pipe)	1.0	0.3

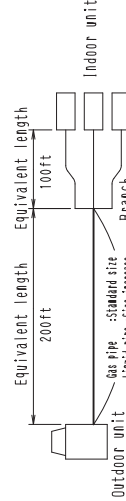


In the above case

(Cooling) Overall equivalent length = 200ft × 1.0 + 100ft = 300ft
 (Heating) Overall equivalent length = 200ft × 0.3 + 100ft = 180ft

The rate of change in cooling capacity when Hp=0ft is thus approximately 0.88 heating capacity when Hp=0ft is thus approximately 1.0

RXYQ168PAYD

2. Rate of change in heating capacity

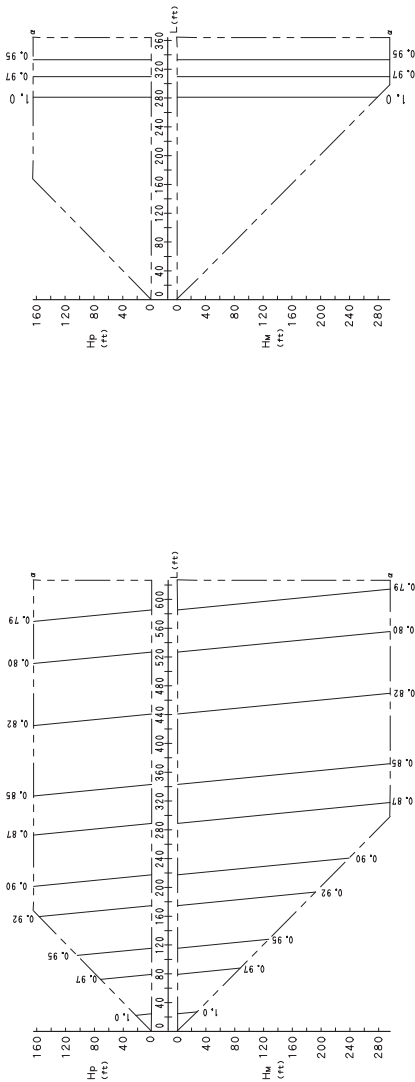

[Explanation of symbols]
 Hp = Level difference (ft) between indoor and outdoor units where indoor unit is inferior position
 Hm = Level difference (ft) between indoor and outdoor units where indoor unit is superior position
 L : Equivalent Pipe length (ft)
 α : Rate of change in cooling / heating Capacity


[Diameter of the main pipes (standard size)]

Model	gas	liquid
RXYQ168PAYD	φ 1-1/8	φ 5/8

[Temper grade and Thickness]

Temper grade	O Type	1/2H Type
Outer diameter	φ 1/2	φ 5/8
Minimum Wall Thickness	0.80	0.99
	0.80	0.99
	1.10	

1. Rate of change in cooling capacity

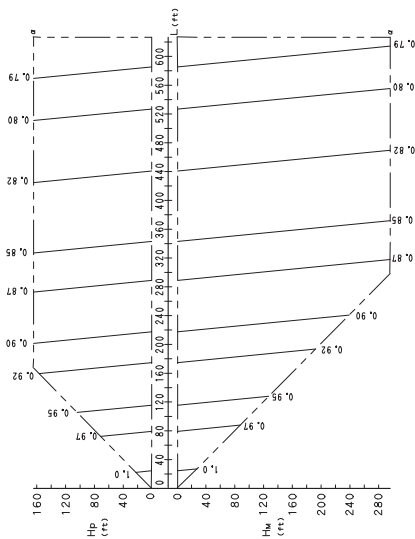

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 • Condition: Indoor unit combination ratio does not exceed 100%.

$$\text{Maximum A/C capacity of outdoor units} = \text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination}$$

$$\times \text{Capacity change rate due to piping length to the farthest indoor unit}$$
 • Condition: Indoor unit combination ratio exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination}$$

$$\times \text{Capacity change rate due to piping length to the farthest indoor unit}$$
- When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]

Model	gas	liquid
RXYQ168PAYD	φ 1-1/4	φ 3/4

5. Read cooling / heating capacity rate of change in the above figures based on the following equivalent length.


$$\text{Overall equivalent length} = (\text{Equivalent length to main pipe}) \times \text{Correction factor} + (\text{Equivalent length after branching})$$

Choose a correction factor from the following table.

When cooling capacity is calculated: gas pipe size
 When heating capacity is calculated: liquid pipe size

Rate of change (object piping)	Correction factor
Cooling (gas pipe)	Standard size
Heating (liquid pipe)	Size increase
	1.0
	0.5
	1.0
	0.3

(Example)

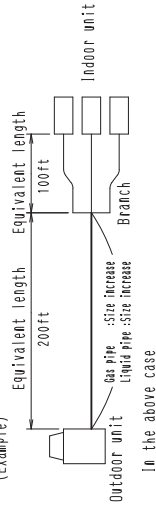


In the above case
 (Cooling) Overall equivalent length = 200ft × 0.5 + 100ft = 200ft
 (Heating) Overall equivalent length = 200ft × 0.3 + 100ft = 160ft

The rate of change in cooling capacity when Hp=0ft is thus approximately 0.88 heating capacity when Hp=0ft is thus approximately 1.0

C: 3D060092B

RXYQ192PAYD

2. Rate of change in heating capacity

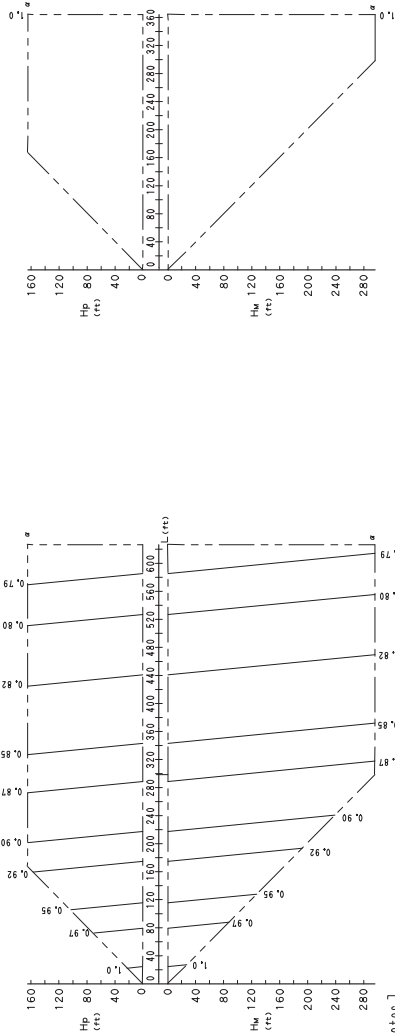

[Explanation of symbols]
 Hp :Level difference between indoor and outdoor units
 where indoor unit in inferior position
 Hm :Level difference between indoor and outdoor units
 where indoor unit in superior position
 L : Equivalent pipe length(m)
 α : Rate of change in cooling / heating Capacity
 [Diameter of the main pipes(standard size)]

Model	gas	liquid
RXYQ192PAYD	φ 1-1/8	φ 5/8

[Temper, grade and Thickness]

Temper grade	□ Type	1/2H Type
Outer diameter	φ 5/8	φ 3/4
Minimum Wall Thickness	0.99	0.80
		0.80
		0.99
		1.10

5. Read cooling / heating capacity rate of change in the above figures based on the following equivalent length.

Overall equivalent length=
 (Equivalent length to main pipe)×Correction factor÷(Equivalent length after branching)


Choose a correction factor from the following table.

When cooling capacity is calculated: gas pipe size

When heating capacity is calculated: liquid pipe size

Rate of change (object piping)	Correction factor
Cooling (gas pipe)	Standard size Size increase
Heating (liquid pipe)	1.0
	0.5
	1.0
	0.4


(Example)



In the above case
 (Cooling) Overall equivalent length=200ft×1.0+100ft=300ft
 (Heating) Overall equivalent length=200ft×0.4+100ft=180ft

The rate of change in cooling capacity when Hp=0ft is thus approximately 0.83 heating capacity when Hp=0ft is thus approximately 1.0

1. Rate of change in cooling capacity

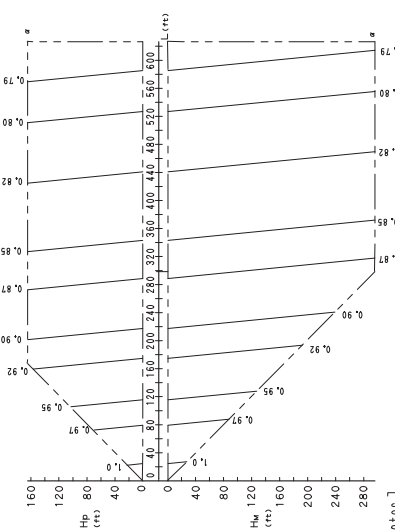

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units

• Condition: Indoor unit combination ratio does not exceed 100%.

Maximum A/C capacity of outdoor units = A/C capacity of outdoor units obtained from capacity characteristic table at the 100% combination
 × [Capacity change rate due to piping length to the farthest indoor unit]

• Condition: Indoor unit combination ratio exceeds 100%.


Maximum A/C capacity of outdoor units = A/C capacity of outdoor units obtained from capacity characteristic table at the combination
 × [Capacity change rate due to piping length to the farthest indoor unit]

- When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]


Model	gas	liquid
RXYQ192PAYD	φ 1-1/4	φ 3/4

RXYQ216PYDNR

1. Rate of change in cooling capacity

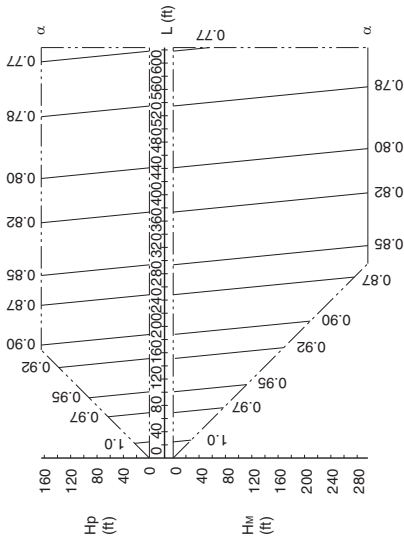

2. Rate of change in heating capacity

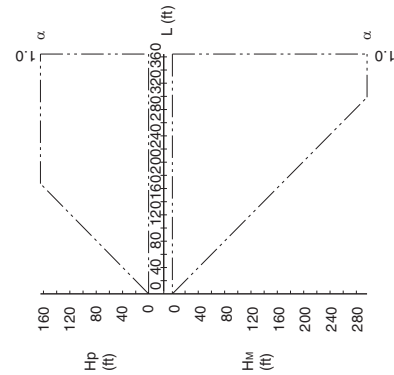

[Explanation of symbols]
 Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position
 Hm : Level difference (ft) between indoor and outdoor units where indoor unit in superior position
 L : Equivalent pipe length (ft)
 α : Rate of change in cooling/heating Capacity

[Diameter of the main pipes (standard size)]

Model	gas	liquid
RXYQ216PYDNR	φ 1-1/8	φ 5/8
RXYQ216PTJUR	φ 1-1/8	φ 5/8

[Temper grade and Thickness]

Temper grade	□ Type	1/2H Type
Outer diameter	φ 5/8	φ 3/4
Minimum Wall Thickness	0.99	0.80
		0.99
		1.10

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 · Condition: Indoor unit combination ratio does not exceed 100%.
 [Maximum A/C capacity of outdoor units] = A/C capacity of outdoor units obtained from capacity characteristic table at the 100% combination
 x [Capacity change rate due to piping length to the farthest indoor unit]
 · Condition: Indoor unit combination ratio exceeds 100%.
 [Maximum A/C capacity of outdoor units] = A/C capacity of outdoor units obtained from capacity characteristic table at the combination
 x [Capacity change rate due to piping length to the farthest indoor unit]
- When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]

Model	gas	liquid
RXYQ216PYDNR	φ 1-1/4	φ 3/4
RXYQ216PTJUR	φ 1-1/4	φ 3/4

5. Read cooling/heating capacity rate of change in the above figures based on the following equivalent length.


Overall equivalent length = [Equivalent length to main pipe] × Correction factor + [Equivalent length after branching]

Choose a correction factor from the following table.

- When cooling capacity is calculated : gas pipe size
- When heating capacity is calculated : liquid pipe size

Rate of change (object piping)	Correction factor
Cooling (gas pipe)	Standard size Size increase
Heating (liquid pipe)	1.0 0.5
	1.0 0.4

(Example) Equivalent length Equivalent length

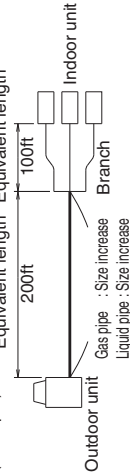

In the above case


(Cooling) Overall equivalent length = 200ft × 0.5 + 100ft = 200ft
 (Heating) Overall equivalent length = 200ft × 0.4 + 100ft = 180ft

The rate of change in cooling capacity when Hp = 0ft is thus approximately 0.86 heating capacity when Hp = 0ft is thus approximately 1.0


3D059678

RXYQ240PYDNR

1. Rate of change in cooling capacity

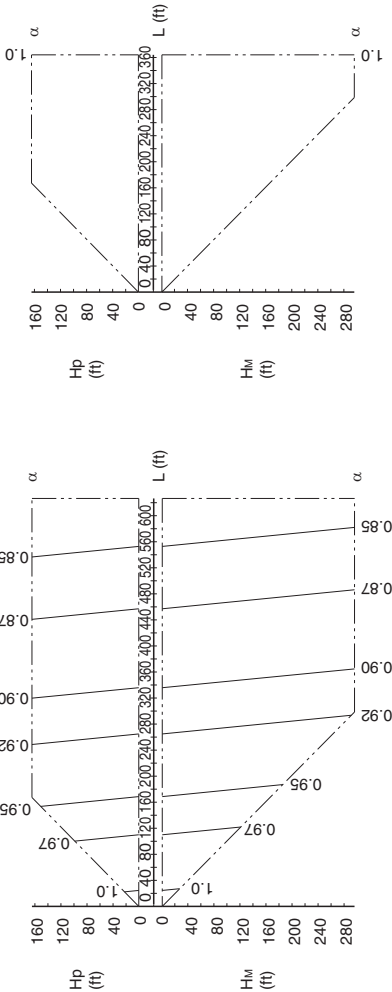

2. Rate of change in heating capacity

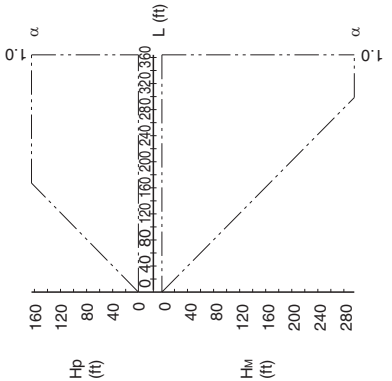

[Explanation of symbols]
 Hp : Level difference (ft) between indoor and outdoor units where indoor unit in inferior position
 Hm : Level difference (ft) between indoor and outdoor units where indoor unit in superior position
 L : Equivalent pipe length (ft)
 α : Rate of change in cooling/heating Capacity

[Diameter of the main pipes (standard size)]

Model	gas	liquid
RXYQ240PYDNR	φ 1-3/8	φ 5/8
RXYQ240PTJUR	φ 1-3/8	φ 5/8

[Temper grade and Thickness]

Temper grade	□ Type		1/2H Type	
	φ 1/2	φ 3/4	φ 7/8	φ 1-1/8
Outer diameter	φ 5/8	φ 3/4	φ 7/8	φ 1-1/8
Minimum Wall Thickness	0.80	0.99	0.80	0.99
	0.80	0.99	0.80	1.21

[Notes]

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.
 Calculating A/C capacity of outdoor units
 · Condition: Indoor unit combination ratio does not exceed 100%.

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] \times \left[\frac{\text{Capacity change rate due to piping length to the farthest indoor unit}}{\text{Capacity change rate due to piping length to the farthest outdoor unit}} \right]$$
 · Condition: Indoor unit combination ratio exceeds 100%.

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] \times \left[\frac{\text{Capacity change rate due to piping length to the farthest indoor unit}}{\text{Capacity change rate due to piping length to the farthest outdoor unit}} \right]$$

4. When overall equivalent pipe length is 295.3ft or more, the diameter of the main gas and liquid pipes (outdoor unit-branch sections) must be increased.
 When level difference is 164.0ft or more, the diameter of the main liquid pipe (outdoor unit-branch sections) must be increased.
 [Diameter of above case]

Model	gas	liquid
RXYQ240PYDNR	Not Increased	φ 3/4
RXYQ240PTJUR	Not Increased	φ 3/4


5. Read cooling/heating capacity rate of change in the above figures based on the following equivalent length.
 Overall equivalent length = (Equivalent length to main pipe) × Correction factor + (Equivalent length after branching)

Choose a correction factor from the following table.

- When cooling capacity is calculated : gas pipe size
- When heating capacity is calculated : liquid pipe size

Rate of change (object piping)	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	240
Heating (liquid pipe)	1.0	0.4

(Example) In case of RXYQ240PYDNR

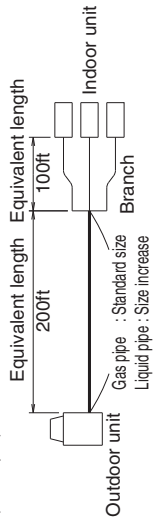

In the above case


(Cooling) Overall equivalent length = 200ft × 1.0 + 100ft = 300ft
 (Heating) Overall equivalent length = 200ft × 0.4 + 100ft = 180ft

The rate of change in cooling capacity when Hp = 0ft is thus approximately 0.88
 heating capacity when Hp = 0ft is thus approximately 1.0

3D056625A

10. Operation Limits

RXYQ72, 96, 120, 144, 168, 192PAYD / 216, 240PYDNR

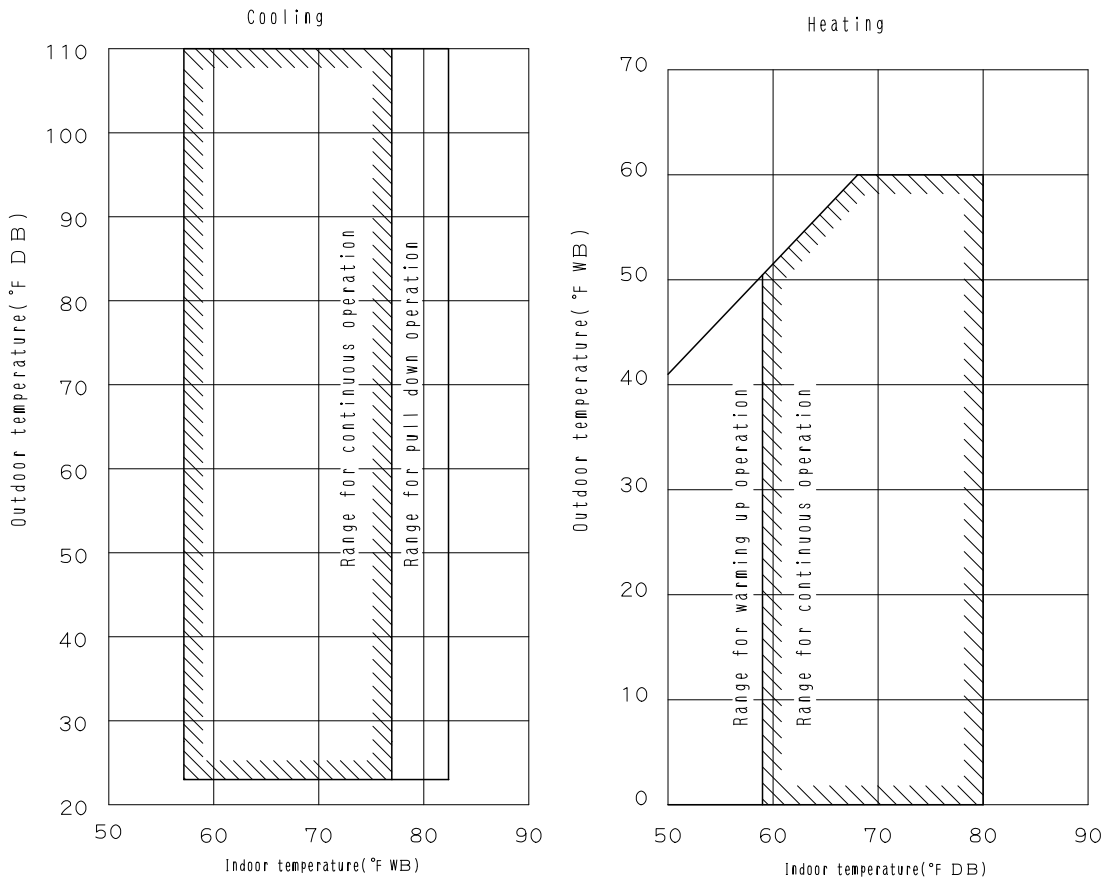

3D043026D


Note: These figures assume the following operating conditions:
 Indoor and outdoor units:
 Equivalent pipe length: 25ft
 Level difference: 0

11. Sound Levels

Overall

Model	Power Supply	60Hz/460V
RXYQ72PAYD		58
RXYQ96PAYD		58
RXYQ108PAYD		60
RXYQ144PAYD		61
RXYQ168PAYD		61
RXYQ192PAYD		62
RXYQ216PYDNR		62
RXYQ240PYDNR		63

dBA

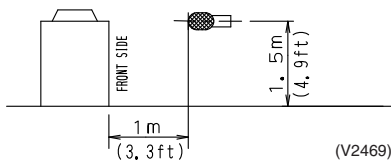

Note:


Sound level:

Anechoic chamber conversion value, measured at a point 3.3ft in front of the unit at a height of 4.9ft.


During actual operation, these values are normally somewhat higher as a result of ambient conditions.

Octave Band Level


RXYQ72PAYD

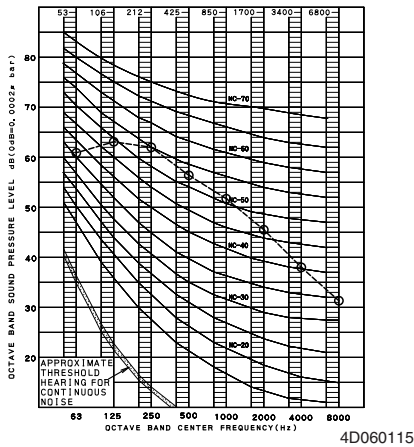


RXYQ96PAYD

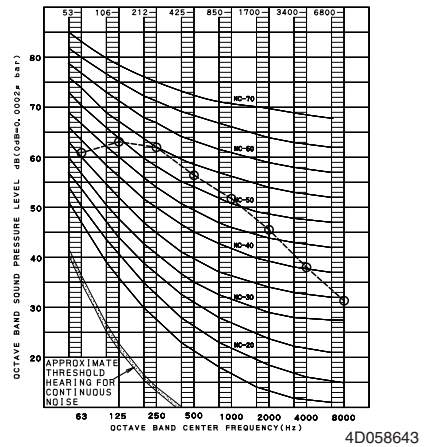

RXYQ108PYD

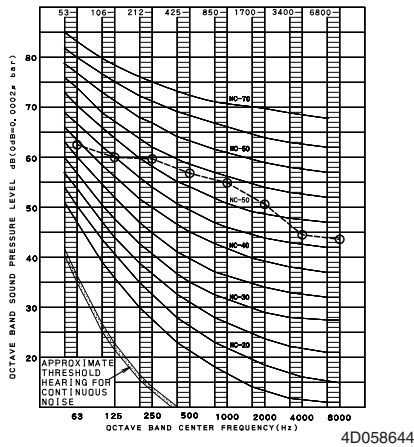



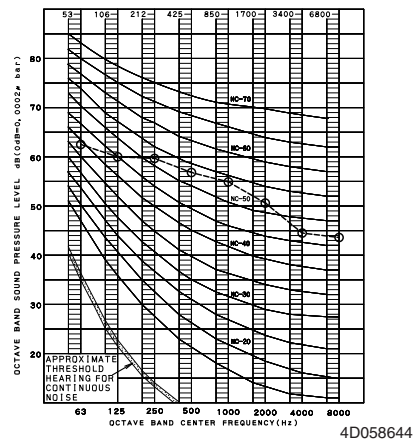



RXYQ120PYDNR

















12. Accessories

Standard Accessories

RXYQ72, 96, 108PAYD / 120PYDNR

Name	Clamp(1)	Clamp(2)	Clamp(3)	Vinyl tube	Conduit mounting plate		Manuals, etc.
Quantity	8 pcs.	2 pcs.	1 pc.	4 pcs.	2 pcs.	2 pcs.	1 pc. about each item
Shape	 (Small)		 (Large)				<ul style="list-style-type: none"> · Operation manual · Installation manual · “REQUEST FOR THE INDICATON” label (Installation records) · Add additional refrigerant charge label

Name		Liquid side accessory pipe (1)	Liquid side accessory pipe (2)	Gas side accessory pipe (1)				Gas side accessory pipe (2)	
Quantity	72P type	1 pc.	1 pc.	1 pc.					
	96P type			1 pc.		1 pc.		1 pc.	
	108P type 120PYDNR					1 pc.		1 pc.	
Shape									
				φ3/4	φ7/8	φ1	φ1-1/8	φ7/8	φ1

Name		High side equalizer accessory pipe (1)	High side equalizer accessory pipe (2)	Low side equalizer accessory pipe (1)	Low side equalizer accessory pipe (2)	L type accessory joint (1)	L type accessory joint (2)
Quantity	72P type	1 pc.	1 pc.	1 pc.	1 pc.	1 pc.	2 pcs.
	96P type						
	108P type 120PYDNR						
Shape							
			φ3/4	O.D φ1	I.D φ1	φ1	φ3/4

Optional Accessories (For Unit)
RXYQ72~192PAYD / 216~240PYDNR

Series		VRV III				
Optional accessories		RXYQ72PAYD	RXYQ96PAYD	RXYQ108PAYD	RXYQ144PAYD RXYQ168PAYD	RXYQ192PAYD RXYQ216PYDNR RXYQ240PYDNR
Distributive piping	Refnet header	Model	KHRP26M22H (Max. 4 branch) KHRP26M33H (Max. 8 branch)	KHRP26M22H (Max. 4 branch) KHRP26M33H (Max. 8 branch) KHRP26M72H (Max. 8 branch)	KHRP26M22H (Max. 4 branch) KHRP26M33H (Max. 8 branch) KHRP26M72H (Max. 8 branch)	KHRP26M22H (Max. 4 branch) KHRP26M33H (Max. 8 branch) KHRP26M72H (Max. 8 branch) KHRP26M73HU (Max. 8 branch)
		AS No.	AS3802560	AS3802560	AS3802560	AS3803567
		Z No.	—	—	—	—
	Refnet joint	Model	KHRP26A22T KHRP26A33T	KHRP26A22T KHRP26A33T KHRP26M72TU	KHRP26A22T KHRP26A33T KHRP26M72TU	KHRP26A22T KHRP26A33T KHRP26M72TU KHRP26M73TU
		AS No.	AS3802560 (KHRP26M22T, KHRP26M33T)	AS3803118 (KHRP26M72TU)	AS3803118 (KHRP26M72TU)	AS3803566 (KHRP26M73TU)
		Z No.	—	—	—	—
Outdoor unit multi connection piping kit	Model	—	—	—	BHFP22P100U	
	AS No.	—	—	—	—	
	Z No.	—	—	—	—	

C: 3D060089B

Warning



- Daikin Industries, Ltd.'s products are manufactured for export to numerous countries throughout the world. Daikin Industries, Ltd. does not have control over which products are exported to and used in a particular country. Prior to purchase, please therefore confirm with your local authorized importer, distributor and/or retailer whether this product conforms to the applicable standards, and is suitable for use, in the region where the product will be used. This statement does not purport to exclude, restrict or modify the application of any local legislation.
- Ask a qualified installer or contractor to install this product. Do not try to install the product yourself. Improper installation can result in water or refrigerant leakage, electrical shock, fire or explosion.
- Use only those parts and accessories supplied or specified by Daikin. Ask a qualified installer or contractor to install those parts and accessories. Use of unauthorized parts and accessories or improper installation of parts and accessories can result in water or refrigerant leakage, electrical shock, fire or explosion.
- Read the User's Manual carefully before using this product. The User's Manual provides important safety instructions and warnings. Be sure to follow these instructions and warnings.

If you have any inquiries, please contact your local importer, distributor and/or retailer.



© 2010 Daikin Industries, Limited.

Daikin®, Daikin AC Absolute Comfort®, and its design, VRV®, REFNET™, and Quaternity™ are registered trademarks of Daikin Industries, Limited, All rights reserved. LonWorks® and LON® are registered trademarks of Echelon Corporation. BACnet® is a Data Communication Protocol for Building Automation and Control Networks, developed under the auspices of the American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE).

Cautions on product corrosion

1. Air conditioners should not be installed in areas where corrosive gases, such as acid gas or alkaline gas, are produced.
2. If the outdoor unit is to be installed close to the sea shore, direct exposure to the sea breeze should be avoided. If you need to install the outdoor unit close to the sea shore, contact your local distributor.



JMI-0107

Organization:
DAIKIN INDUSTRIES, LTD.
AIR CONDITIONING MANUFACTURING DIVISION

Scope of Registration:
THE DESIGN/DEVELOPMENT AND MANUFACTURE OF COMMERCIAL AIR CONDITIONING, HEATING, COOLING, REFRIGERATING EQUIPMENT, COMMERCIAL HEATING EQUIPMENT, RESIDENTIAL AIR CONDITIONING EQUIPMENT, HEAT RECLAIM VENTILATION, AIR CLEANING EQUIPMENT, MARINE TYPE CONTAINER REFRIGERATION UNITS, COMPRESSORS AND VALVES.



JQA-1452

Organization:
DAIKIN INDUSTRIES
(THAILAND) LTD.

Scope of Registration:
THE DESIGN/DEVELOPMENT AND MANUFACTURE OF AIR CONDITIONERS AND THE COMPONENTS INCLUDING COMPRESSORS USED FOR THEM



EC99J2044

All of the Daikin Group's business facilities and subsidiaries in Japan are certified under the ISO 14001 international standard for environment management.

Dealer

DAIKIN AC (AMERICAS), INC.
1645 Wallace Drive, Suite 110
Carrollton, TX75006
info@daikinac.com
www.daikinac.com

©All rights reserved

● Specifications, designs and other content appearing in this brochure are current as of July 2010 but subject to change without notice.